



Application guide

FLEX CONTROL UNIT DALI-2 family



November 2024

Contents

1 Introduction	03
1.1 The principle	03
2 General information	04
2.1 FLEX Control devices	
2.1.1 Wiring diagrams	05
2.2 Apps	06
2.3 Connectable devices	06
2.3.1 LEDVANCE DALI sensors – DALI-2-certified	07
2.3.2 LEDVANCE DALI pushbutton coupler – function modes	08
2.3.3 Limitations on connectable devices	08
2.4 General installation instructions	09
2.4.1 Safety instructions	09
2.4.2 Wiring instructions	09
2.4.3 Radio optimization	10
2.4.4 Light sensor placement and set point for light regulation	13
3 Control features	14
3.1 Standard features (available without app)	14
3.2 Advanced features (available with app)	14
3.2.1 Tunable White	15
3.2.2 Group control	15
3.2.3 Swarm feature	15
3.3 Special features of FLEX CU RTC DALI-2 HCL TW	15
3.3.1 Human Centric Lighting (HCL)	16
3.3.2 Timer	16
3.4 Demo mode	17
4 Configuration of multiple devices	18
4.1 Overview	18
4.2 Three steps for luminaire production with FLEX Control Unit	19
4.2.1 Step 1: Commissioning of a reference luminaire	19
4.2.2 Step 2: Upload of configuration to multiple FLEX Control Unit	20
4.2.3 Step 3: Assembly of the luminaire in production	22
5 Applications and settings	23
5.1 Stand-alone luminaires with integrated FLEX Control Unit	23
5.1.1 Floor-standing luminaire with 1 x DALI LED driver (with out-of-the-box light functions)	23
5.1.2 Floor-standing luminaire with 2 x DALI LED drivers separating the direct and indirect light	27
5.1.3 Floor-standing luminaire with 1 x DALI LED driver and active HCL function	31
5.2 Single-room applications with integrated FLEX Control Unit	34
5.2.1 Single office (with out-of-the-box light functions)	34
5.2.2 Meeting room with scene control	38
5.2.3 Classroom with daylight harvesting (DLHV) plus light group offset	41
5.2.4 Corridor including standby (infinite timer)	45
5.2.5 Open-plan office including standby	47
5.2.6 Open-plan office including Swarm function	51
5.2.7 Open-plan office including Swarm function and zone division	54

1 Introduction

Our LEDVANCE FLEX CONTROL UNIT DALI-2 system represents a new generation of intelligent, independently operating light control systems. In spite of their compact dimensions, the components of the system are extremely powerful. No matter if the light is controlled manually by pushbuttons or by fully automatic presence and daylight operation, the FLEX CU DALI-2 systems can always be used in a flexible manner. Compared to conventional, purely switchable solutions, energy savings up to 80 % can be achieved while enjoying a significantly higher lighting comfort.


FLEX CU DALI-2 devices are suitable especially for lighting control at single or group workplaces, corridors, classrooms or sanitary rooms. Through the integrated Bluetooth Low Energy (BLE) radio module, it is possible to control the light via an iOS or Android smart phone by the DALI CONTROL APP or to modify the control profile by the DALI CONFIG APP. Access via Bluetooth (FLEX) can be restricted via password. This guide will show you the most important features and provide you with troubleshooting instructions.

1.1 The principle

The FLEX CU DALI-2 TW, FLEX CU RTC DALI-2 HCL TW or FLEX CU FLUSH MOUNT DALI-2 TW Control devices are the central element of the system (application controller). Based on signals coming from sensors and manual user interfaces, it controls the light level of connected luminaires according to the chosen function mode and its individual parameterization. The integrated software-based regulation algorithms and timers allow an automatic change and optimization of the lighting level.

All settings can be read out and modified by the DALI CONFIG APP. Existing configurations can either be overwritten completely via profile upload, or only changed by modifying individual parameters.

FLEX CU DALI-2 devices can be adapted in a modular way according to the application requirements or application size. Thanks to its plug-and-play capability, the control unit starts to detect and configure connected DALI components automatically after power-up. Hot-plugging of DALI devices after power-up is not recommended and may lead to unwanted behavior.

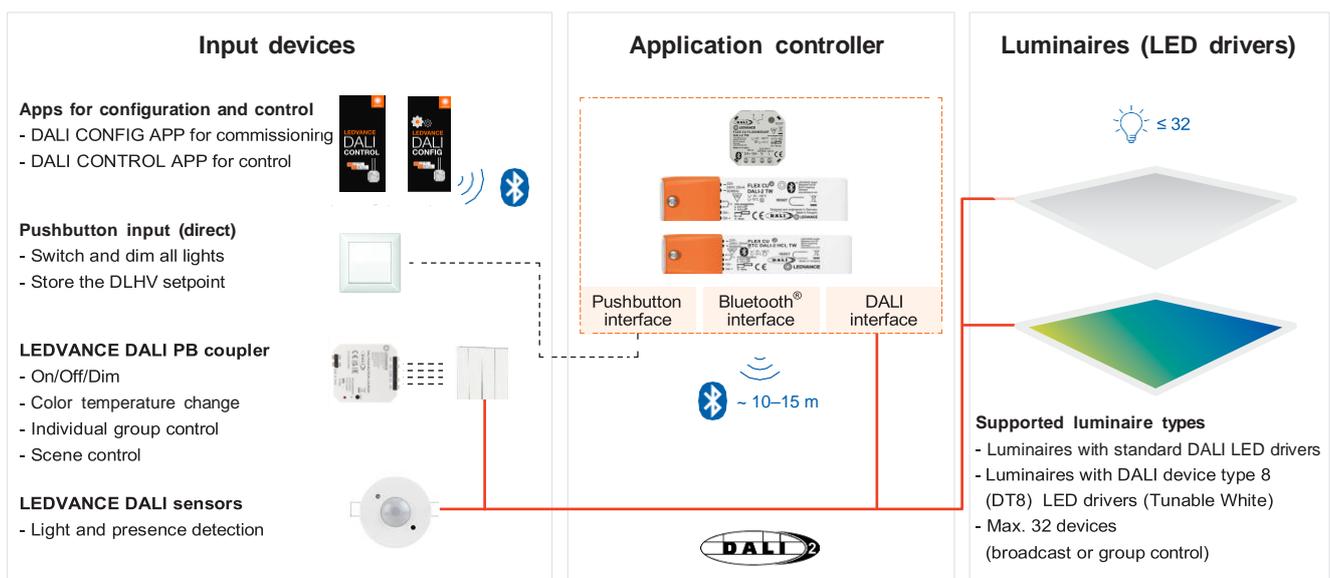

2 General information

FLEX CU DALI-2 devices are DALI lighting controls with a Bluetooth Low Energy (BLE) interface. All FLEX CU DALI-2 devices are powerful stand-alone units which can be configured and controlled with a smart device.

2.1 FLEX Control devices

Three hardware types of FLEX CU DALI-2 devices are available:

- FLEX CU FM DALI-2 TW (FM=Flush Mounted)
- FLEX CU DALI-2 TW
- FLEX CU DALI-2 TW RTC (RTC = with integrated real-time clock)



FLEX CU FM DALI-2 TW



FLEX CU DALI-2 TW



FLEX CU DALI-2 TW RTC

Control features

Plug-&-play, out-of-the-box features	Yes	Yes	Yes
Control and configuration via app (Android/iOS)	Yes	Yes	Yes
Support of LEDVANCE DALI and DALI-2 sensors and couplers	Yes	Yes	Yes
No. of different connectable pushbuttons	1	1	2 ¹⁾
DALI grouping	Yes (up to 4)	Yes (up to 4)	Yes (up to 4)
Swarm function (wireless interconnection between controllers)	Yes	Yes	Yes
Mounting type	Flush box	Ceiling integration	Ceiling integration
HCL function (automatic daytime-based color temperature change)	-	-	Yes
Timer functions	-	-	4


1) Second pushbutton needs a resistor in the daisy chain

All three hardware types of FLEX CU DALI-2 devices feature the same electrical parameters:


Electrical parameters	Value
V_{AC}	220-240 V; 50/60 Hz
P	0.3-3 W
t_a	-20 ... +60 °C
IP rating	IP20
Max. DALI load	32 ECGs + 4 LEDVANCE DALI sensors or DALI pushbutton couplers 96 mA

2.1.1 Wiring diagrams


FLEX CU FM DALI-2 TW

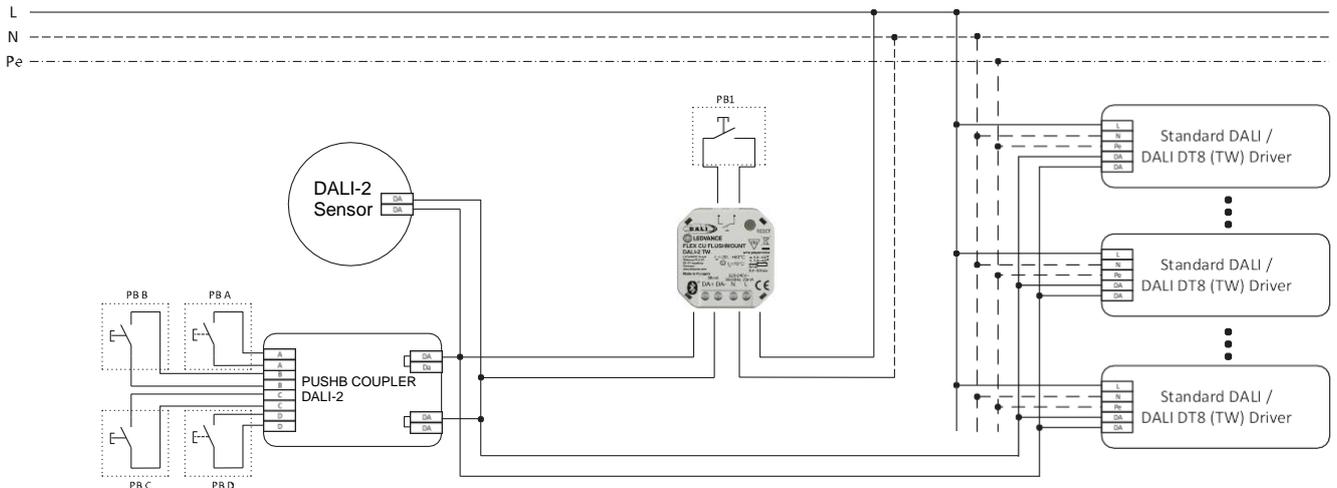

FLEX CU DALI-2 TW

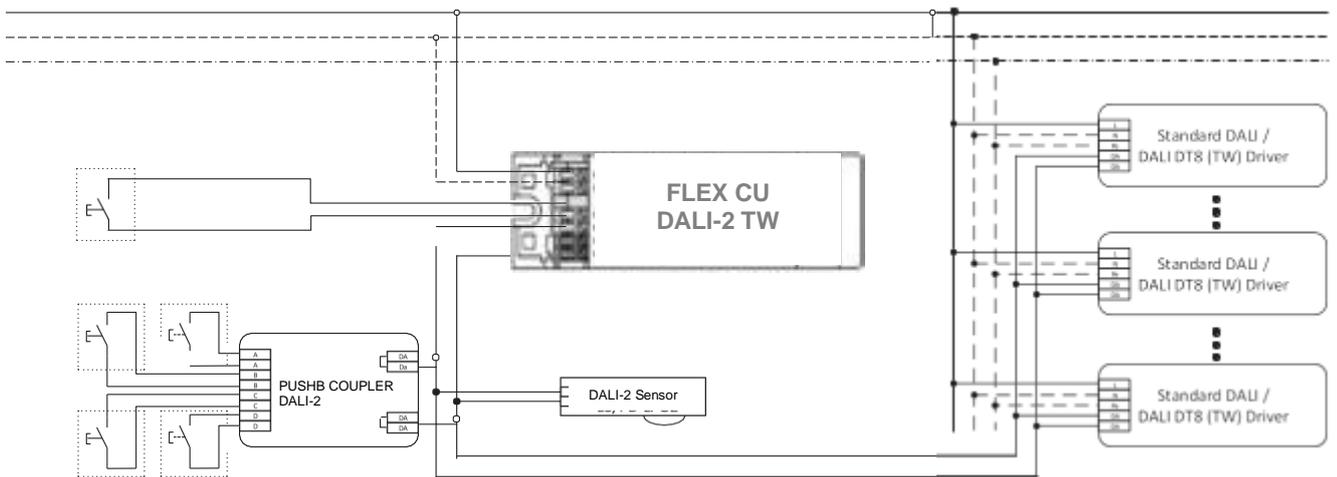

FLEX CU DALI-2 TW RTC

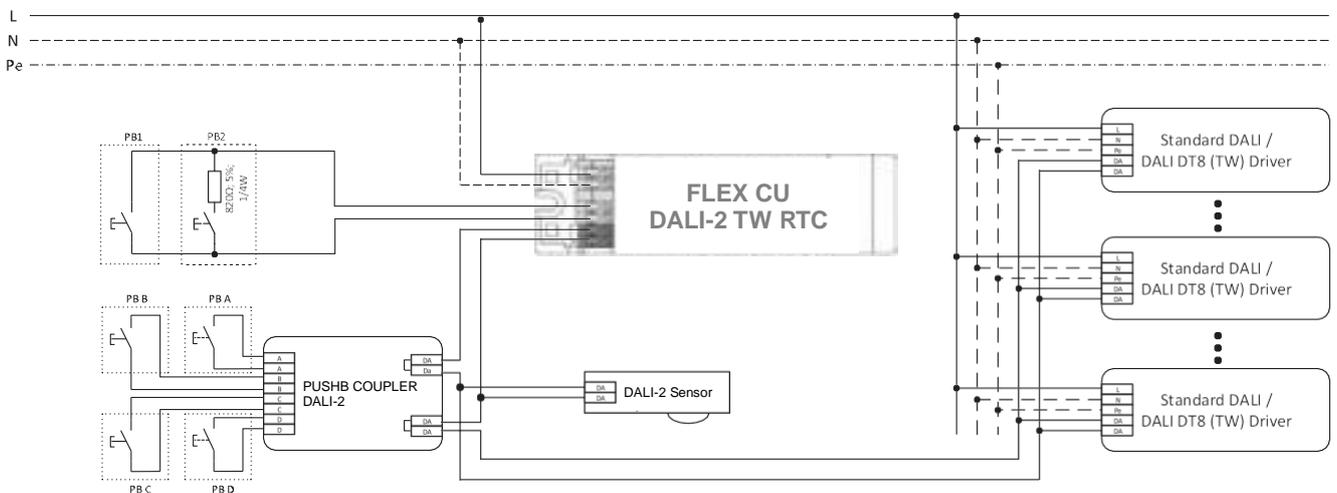

2.2 Apps

DALI CONTROL APP



For system control functions
(end-user app)


DALI CONFIG APP



For system configuration functions
(installer/system manager app)

++

Connectable devices

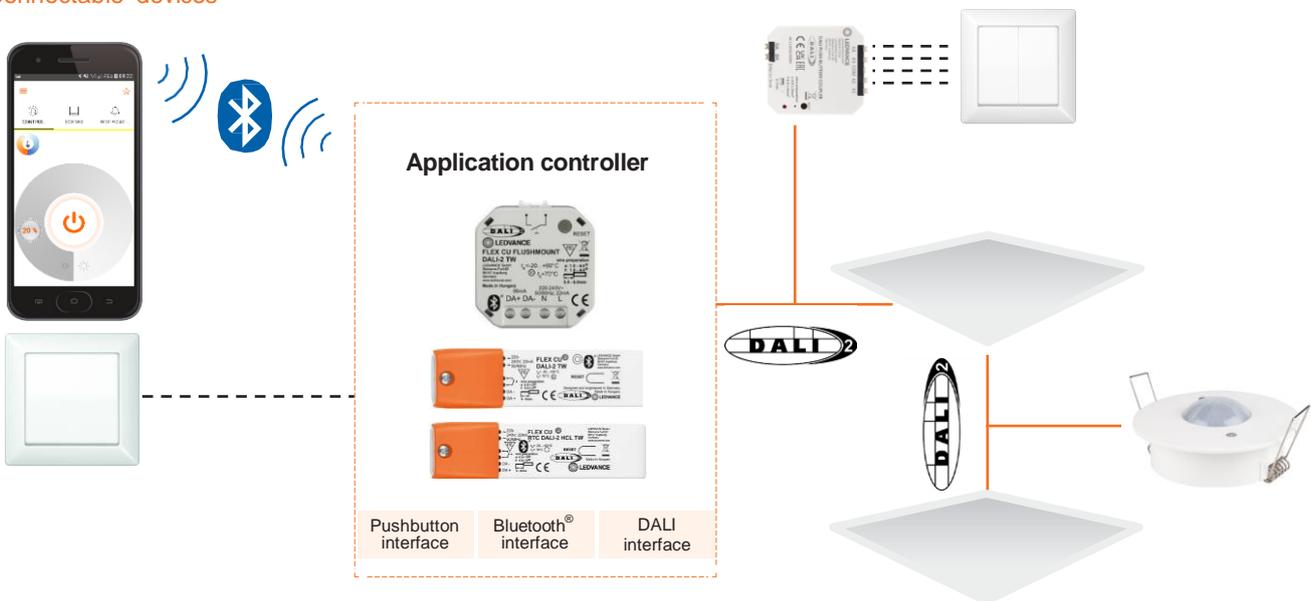

Certified DALI-2 interface

All FLEX Control devices are certified by the DiiA according to:

- IEC 62386-101: System components
- IEC 62386-103: Control devices

Certified product properties

- Application controller
- Provides bus power

Devices and functions supported by the DALI-2 interface

- Standard DALI LED drivers
- DALI-2 LED drivers
- LED drivers (part -207)
- Tunable White drivers (part -208)
- Feedback from drivers (incl. lamp failure)
- Addressing and grouping

Device interactions supported by DALI-2

- Event messages from input devices
- Pushbuttons (part -301)
- Occupancy sensors (part -303)
- Light sensors (part -304)

2.2.1 LEDVANCE DALI sensors – DALI-2-certified

The following components can be combined with all three FLEX Control devices (all dimensions in m):

SENSOR DALI-2 LS-PD-6 IR CI

HIGHLIGHTS:

- DALI-2 certified input device (303, 304)
- Modern reduced design
- Occupancy detection via passive IR element

BENEFITS:

- Ceiling integration with integrated cable clamp
- More than 50,000h lifetime @ t₅₀ = 50° C system
- Powered via DALI bus

H	2.5 m	3.0 m	3.7 m
Ø A	3.0 m	3.0 m	2.0 m
Ø B	6.0 m	7.0 m	8.0 m

SENSOR DALI-2 LS-PD-8 IR CI

HIGHLIGHTS:

- Wide detection range
- DALI-2 certified input device (303, 304)
- Modern reduced design
- Occupancy detection via passive IR element

BENEFITS:

- Ceiling integration with integrated cable clamp
- More than 50,000h lifetime @ t₅₀ = 50° C system
- Powered via DALI bus

H	2.0 m	2.5 m	3.0 m	4.0 m
Ø A	3.0 m	4.0 m	4.5 m	—
Ø B	6.0 m	8.0 m	9.0 m	12.0 m

SENSOR DALI-2 LS-PD-40X5 IR CI

HIGHLIGHTS:

- Wide detection area optimised for corridors (up to 40m)
- DALI-2 certified input device (303, 304)
- Occupancy detection via passive IR element

BENEFITS:

- Ceiling integration with integrated cable clamp
- More than 50,000h lifetime @ t₅₀ = 50° C system
- DALI powered

H	2.0 m	2.5 m	3.0 m	4.0 m
x	12.0 m	16.0 m	16.0 m	—
y	3.0 m	3.0 m	3.0 m	—
Ø A	—	—	—	—
x	32.0 m	40.0 m	40.0 m	40.0 m
y	4.0 m	5.0 m	5.0 m	5.0 m

SENSOR DALI-2 LS-PD-24 IR CM

HIGHLIGHTS:

- Wide detection area of up to 24 m
- IP54 protection for underground parking
- Occupancy detection via passive IR element

BENEFITS:

- Ceiling integration with integrated cable clamp
- More than 50,000h lifetime @ t₅₀ = 50° C system
- DALI powered

H	2.0 m	2.5 m	3.0 m	4.0 m
Ø A	4.0 m	5.0 m	5.0 m	5.0 m
Ø B	19.0 m	24.0 m	24.0 m	24.0 m

ACCESSORY FOR SENSORS: SENSOR CM KIT LEDVANCE

HIGHLIGHTS:

- Enables surface and recessed ceiling mounting in addition to the standard use of the product
- Surface mounting will be protection class IP54
- Recessed ceiling mounting kit includes spring clips and integrated cable clamp

COMPATIBILITY:

The following sensors will be supported:

- SENSOR DALI-2 LS-PD-8 IR CI EAN 4058075841949
- SENSOR DALI-2 LS-PD-40X5 IR CI EAN 4058075843868

SENSOR CM KIT LS-PD-8
 Ø 105
 24.2

SENSOR CM KIT LS-PD-24 / -40x5
 Ø 105
 24.2


[mm]

PERFORMANCE – A COMPARISON

Control unit	DALI-2 LS-PD-6 IR CI	DALI-2 LS-PD-8 IR CI	DALI-2 LS-PD-40X5 IR CI	DALI-2 LS-PD-24 IR CM
Product picture				
DALI-2 input device, infrared presence detector with 6 m movement detection	DALI-2 input device, infrared presence detector with 6 m movement detection	DALI-2 input device, infrared presence detector with 8 m movement detection	DALI-2 input device, infrared presence detector with 16 x 3 m movement detection	DALI-2 input device, infrared presence detector with 24 m movement detection
Mounting height sensor	2.5 m 3.0 m	2.5 m 3.0 m	2.5 m 3.0 m	2.5 m 3.0 m
Tangential motion detection	3.0 m 3.0 m	4.0 m 4.5 m	L 40.0 m/W 5.0 m L 30.0 m/W 5.0 m	5.0 m 5.0 m
Radial presence detection	6.0 m 8.0 m	8.0 m 9.0 m	L 16.0 m/W 3.0 m L 19.0 m/W 3.5 m	24.0 m 24.0 m
Shutter included to select detection area	—	✓	✓	✓
Surface mount kit available	—	✓	✓	Not relevant
Performance/price ranking	Value	Advanced	Advanced	Advanced

A MOVE IN THE RIGHT DIRECTION

The detection range of motion sensors can be divided into two areas:

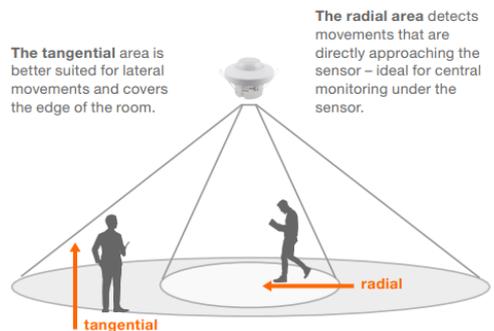

SENSOR ABBREVIATIONS

- LS: Light sensor
- PD: Presence detection
- IR: Infrared
- CI: Ceiling integration
- CM: Ceiling mounting

2.2.2 LEDVANCE DALI-2 pushbutton coupler – function modes

The following pre-programmed function modes while using FLEX CU DALI-2 devices together with the DALI pushbutton coupler. The modes 7 and 8 can be only used in combination with FLEX CU DALI-2 TW RTC.

Name	Function of Input A	Function of Input B	Function of Input C	Function of Input D
1: 1-ch tunable white (Default)	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>	SP: Toggle Scenes LP: Change Color Temp <i>Groups: All (1-4)</i>	SP: Recall Scene 1 LP: --- <i>Groups: All (1-4)</i>	SP: Recall Scene 2 LP: --- <i>Groups: All (1-4)</i>
2: 2-ch tunable white	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 1</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 2</i>	SP: --- LP: Change Color Temp <i>Group: 1</i>	SP: --- LP: Change Color Temp <i>Group: 2</i>
3: 2-ch dimming	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 1</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 2</i>	SP: ON LP: --- <i>Groups: All (1-4)</i>	SP: OFF LP: --- <i>Groups: All (1-4)</i>
4: 4-ch dimming	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 1</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 2</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 3</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 4</i>
5: Scene control	SP: Recall Scene 1 LP: --- <i>Groups: All (1-4)</i>	SP: Recall Scene 2 LP: --- <i>Groups: All (1-4)</i>	SP: Recall Scene 3 LP: --- <i>Groups: All (1-4)</i>	SP: Recall Scene 4 LP: --- <i>Groups: All (1-4)</i>
6: 1 Light regulation	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Groups: All with active LR</i>	SP: Resume LR LP: --- <i>Groups: All with active LR</i>	SP: OFF LP: --- <i>Groups: All (1-4)</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>
7: TW & HCL Broadcast	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>	SP: Toggle Scenes LP: Change Color Temp <i>Groups: All (1-4)</i>	SP: Recall Scene 1 LP: --- <i>Groups: All (1-4)</i>	SP: HCL Resume LP: --- <i>Groups: All (1-4)</i>
8: BIOLUX	SP: HCL-1 ON / OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>	SP: --- LP: Change Color Temp <i>Groups: All (1-4)</i>	SP: HCL-2 ON/OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>	SP: HCL-3 ON/OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>



¹⁾ HCL only applicable with FLEX CU DALI-2 TW RTC Control device

* SP = Short press

** LP = Long press

2.2.3 Limitations on connectable devices


Relevant for all three FLEX CU DALI-2 devices:

FLEX CU FM DALI-2 TW, FLEX CU DALI-2 TW and FLEX CU DALI-2 TW RTC (with integrated real-time clock)

Number of LEDVANCE DALI-2 sensors	Number of LEDVANCE DALI PB couplers	Max. number of DALI-2 ECGs (at 25 °C ambient temperature)	Max. number of DALI-2 ECGs (at 60 °C ambient temperature)
1	0	32	32
	1	32	32
	2	32	32
	3	32	32
	4	32	32
2	0	32	32
	1	32	32
	2	32	32
	3	32	32
	4	32	32
3	0	32	32
	1	32	32
	2	32	32
	3	32	30
	4	28	26
4	0	32	30
	1	30	28
	2	28	26
	3	26	24
	4	24	22

2.3 General installation instructions

2.3.1 Safety instructions




- Please read these operating instructions carefully before installing and using the FLEX CU DALI-2 devices. This is the only way to ensure that you use the equipment safely and correctly. Keep these operating instructions in a safe place for future reference. You should make sure that everyone who uses FLEX CU DALI-2 devices has read these operating instructions.
- Apart from the explicitly mentioned components, no further control units may be connected to the DALI lines.
- FLEX CU DALI-2 devices may only be installed by qualified personnel who have been appropriately trained and who have the relevant authority. The installation personnel must be familiar with the operating instructions. Power must be switched off before any work is undertaken on the system.
- FLEX CU DALI-2 devices units are especially designed for independent installation (FLEX CU DALI-2 TW) or flush-mounted boxes (FLEX CU FM DALI-2 TW) thanks to pre-mounted end-cap.
- The relevant safety and accident prevention regulations must be observed.
- If the control cables, sensor cables or the switch and/or the synchronization input is wired with external voltage, particularly with a mains voltage of 230 V, the unit may be destroyed.

2.3.2 Wiring instructions

DALI, sensor and pushbutton wires must never be connected or applied with mains voltage. Before connecting any new components, the mains supply of the control unit has to be switched off. After switching on the mains supply, the control unit automatically detects all connected components. The plug-and-play principle is valid, which means that there is no need to manually configure components to ensure a proper operation.

Interfaces (wired and wireless)	Maximum value
DALI control interface	Max. total wire length: 300 m
Pushbutton interface	Max. total wire length: 50 m (PB2 = 5 m for FLEX CU DALI-2 TW RTC only)
Wireless Bluetooth interface	Max. connectivity range: 15 m

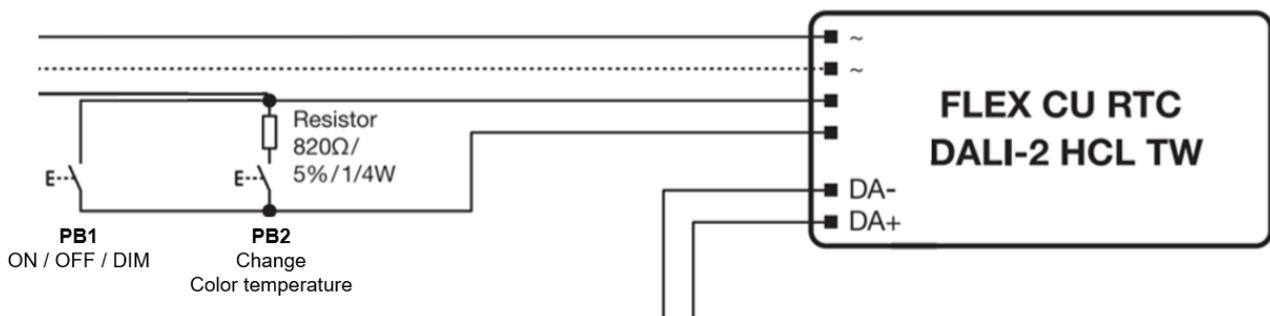

Wiring of the DALI connection

The DALI standard requires basic insulation against mains. To fulfill the safety regulations, an additional insulation against mains is required. For DALI wiring, a cable suitable for line voltage is mandatory (even if in normal condition only 17 V_{DC} will be supplied). The terminals of the FLEX Control products are suitable for wire sections of 0.5 mm² to 2.5 mm². In order to not reduce the maximum cable length of a DALI installation (300 m), a wire section of at least 1.5 mm² is recommended.

DALI wires can be run with line voltage in the same cable. This means that, for example, an NYM-J 5 x 1.5 sheathed cable (where two wires are used for the DALI communication) is suitable. For DALI wiring, the usage of control and data cables such as LIYY or bell wire cables such as YR or comparable products are not allowed, and a reliable operation may not be ensured.

Wiring of directly connected pushbuttons

For the wiring of directly connected pushbuttons, a cable suitable for line voltage must be used. In principle, the pushbutton wires can be run in the same cable as the mains supply.

In case of longer cable lengths, or in case of in coupling disturbances that lead to a measurable AC disturbance voltage on the pushbutton wires, which may therefore lead to malfunctions, the usage of a DALI pushbutton coupler (or at least a separate pushbutton connection cable) is recommended.

FLEX CONTROL UNIT DALI-2 FAMILY

The pushbutton wires have to be run locally separated from lamp or LED supply wires. Parallel-running lamp or LED supply wires may have a negative impact on the pushbutton function.

Wherever possible, crossing of pushbutton wires with lamp or LED supply wires should be at right angles to minimize capacitive coupling of disturbance signals.

Usage of small-signal or low-voltage pushbuttons is allowed if they provide a sufficient isolation (isolation voltage of at least 1500 V).


2.3.3 Radio optimization

The wireless Bluetooth Low Energy (BLE) interface is based on the Bluetooth 4.0 protocol.

Connectivity range: ≤ 15 m


FLEX CU DALI-2 TW, FLEX CU DALI-2 TW RTC

Mounting instructions

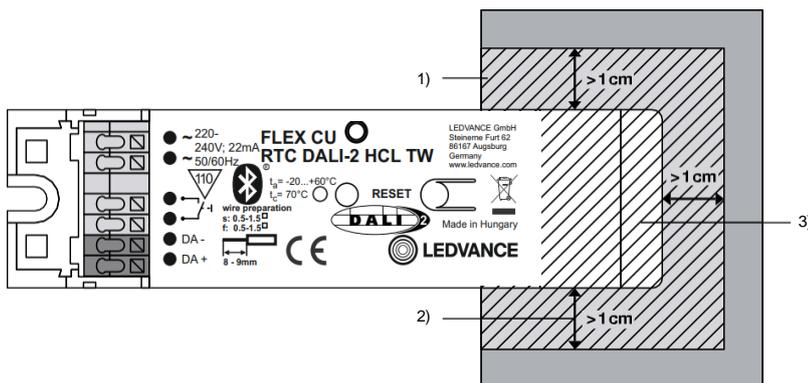

FLEX CU FM DALI-2 TW

Mounting instructions

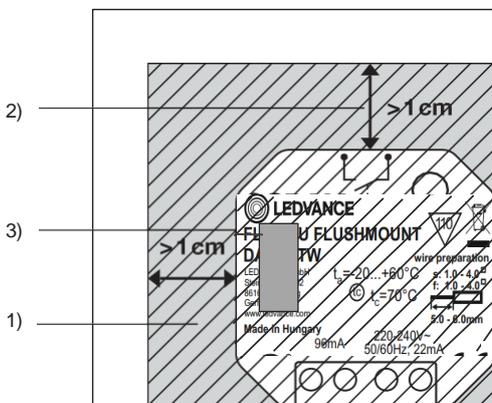


- 1) Do not place any mains voltage or LED supply wires within or close to this area
- 2) Recommended minimal distance to metal parts
- 3) Placement of integrated radio transmitter antenna

Guidelines for product placement to optimize the stability and effective range of the FLEX controller connection

1. Preferable installation on systems free from metal obstructions or material that heavily weakens the radio frequency signal (e.g. fiber-reinforced plastic).
2. Do not place inside metal boxes!
3. Keep a distance between the antenna area and the mounting surface (see best practice below).
4. Do not wire cables (mains voltage, LED supply wires) near the antenna area and, if possible, out of the device border.
5. Consider an installation height above the furniture and human obstacles (e.g. >1.6 m above the floor).

Best practice examples:

Floor-standing luminaire mounting

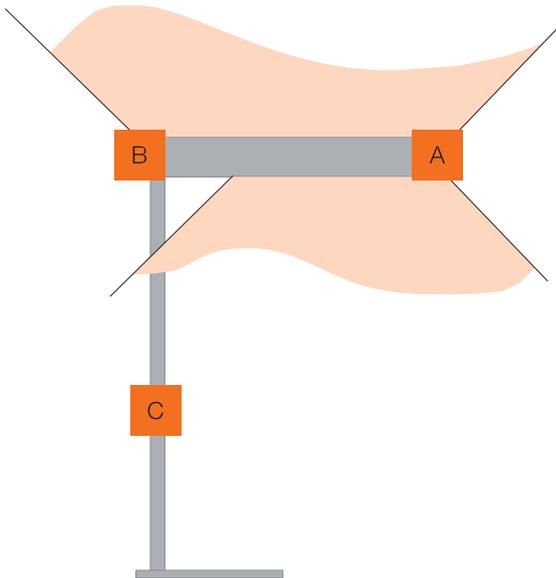


A: Luminaire head
 B: Transition area from pole to head
 C: Pole

General mounting rules:


- ✗ Metal surrounding the antenna
- ✗ Wires over antenna area
- ✗ No space for free BT transmission
- ✓ Non-metallic surrounding material
- ✓ > 1 cm of free space around antenna
- ✓ Space for free BT transmission

A Luminaire head:

On-top mounting

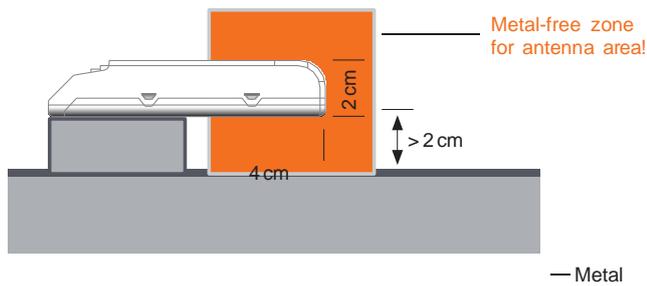


End mounting

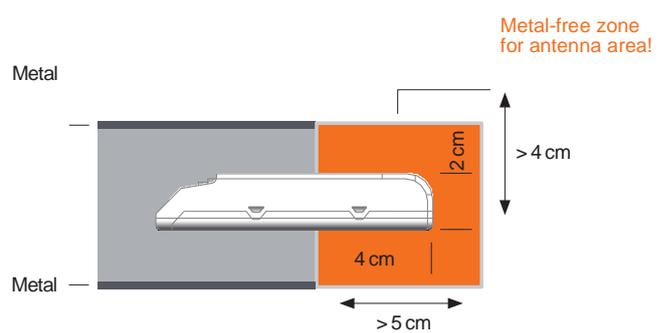


B Transition area:

Corner mounting

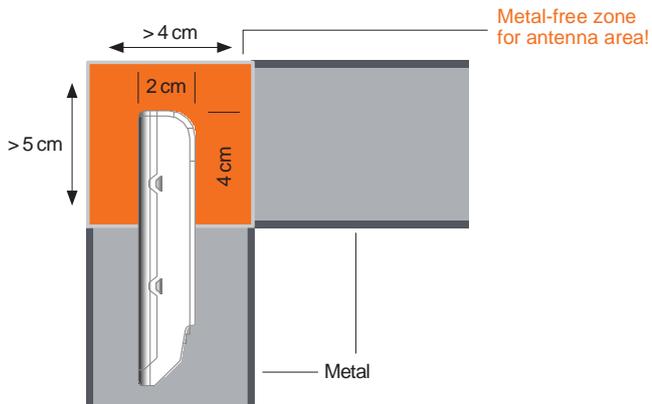

C Pole:

Pole integration

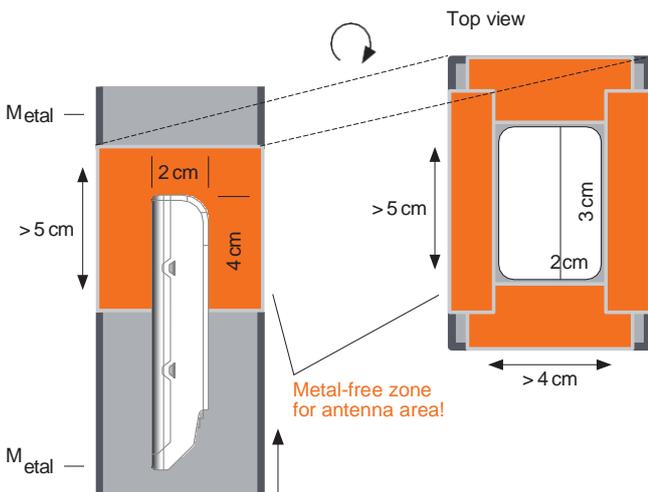

Function validation

To validate the assembly, the construction must be checked and the connection stability and connection distance tested. The check should be done using:

- The DALI CONFIG APP and a mobile device for testing the range of the mobile device to the FLEX controller BT antenna
- In case of Swarm function: A second FLEX Control device to test the point-to-point range between Swarm participants


Please note:

The result of the validation is not an index of replicability in all environments and application situations.

2.3.4 Light sensor placement and set point for light regulation

The light sensor measures the sum of daylight and artificial light reflected by a reference surface (e.g. tabletop or floor). For this purpose, the sensor must be directed as perpendicularly as possible to the reference surface. To achieve a proper function, the sensor must be placed so that the sensor receives the reflected light of luminaires connected to DALI channel 1.

Direct sunlight falling on the sensor has to be avoided, as well as unwanted measurement of the outside brightness through the sensor. Therefore, the sensor must not be mounted too close to the window. A sufficient change in the sensor reading through a change in the illumination is only guaranteed if the maximum mounting height is respected.

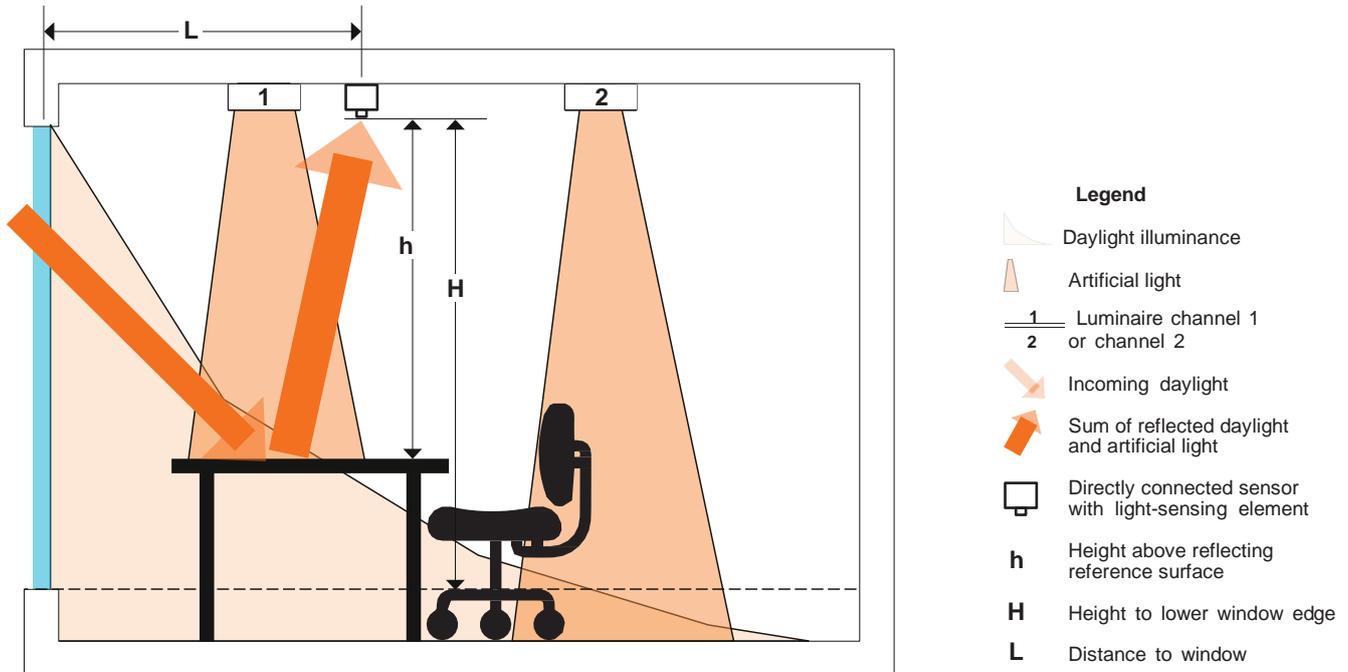

Min. and max. values that have to be observed
 $L > 0.5 \times H$

Set point adjustment for daylight-dependent control

For the use of the daylight-dependent control function, a set point value must be defined. The set point adjustment must be performed with minimum daylight and additional light.

Automatic definition of the set point

Via an automatic setup process, the set point is set to 80 % of the maximum illuminance given by the artificial light. During the auto-setup process, the sensor LED flashes red and green alternatingly for about 3 minutes. For a meaningful measurement of the illuminance, it is important that there are no people or objects between the sensor and the reference surface until the auto-setup process is completed.

Manual adjustment of the set point

The set point for daylight control can be preset individually via the DALI CONFIG APP.

3 Control features

3.1 Standard features (available without app)

These are out-of-the-box functions that can be used right after connecting the devices and powering them up (no DALI CONFIG APP needed!).



Basic system (controller + luminaire + pushbutton)

- Switch the light on and dim it via the directly connected pushbutton.
- Save the switch-on light level via double press on the pushbutton.
- Wireless light control with the User App (FLEX Control).
- DALI CONFIG APP access will be blocked after two hours to avoid hacking (the access will be enabled for two hours after each power cycle).

One or more LEDVANCE DALI-2 sensor/s connected

- Presence detection enabled automatically (15-minute timer).
- Switch the light on and dim it via the connected pushbutton.
- Daylight harvesting enabled by double press on the connected pushbutton (FLEX CU DALI-2 TW RTC light regulation will be started automatically after clock synchronization via the app).

One or more LEDVANCE DALI-2 pushbutton coupler/s connected

- Automatically supported
 - PB 1: Switch and dim

3.2 Advanced features (available with app)

These functions are only configurable via the DALI CONFIG APP.

Load/save a profile

- Main pre-programmed office application available
- Save all settings as a custom profile and apply it on multiple rooms

Light regulation/daylight harvesting (DLHV)

- Enable/disable
- Change setpoint
- Enable/disable switch-off when enough daylight is present

Motion detection

- Enable/disable
- Change delay time to choose between energy saving and user comfort
- Test mode to check the detection area
- Standby level to dim down before switching off

Additional settings

- State after power failure
- Min./max. DALI levels and color temperature
- Pushbutton interface configuration
- Adjustable PIR inhibit timer



3.2.1 Tunable White

The Tunable White function is enabled automatically if one (or more) DALI device type 8 Tunable White LED driver/s (DALI DT8 TW) is/are connected.

Out-of-the-box features

- The DALI CONTROL APP will automatically display a color temperature control
- DALI PRO PB coupler supports color temperature control without using the app
 - Button 1: On/off/dim
 - Button 2: Change color temperature

Configurable with DALI CONFIG APP

- Store and recall scenes
- Change min. and max. color temperature limits
- Scene re-call with the DALI pushbutton coupler

3.2.2 Group control

Group control can be configured via the DALI CONFIG APP and used via the DALI CONTROL APP.

Groupcast

- Individual control of up to four groups (dimming/changing color temperature)
- Flexible group assignment of every single luminaire

Extended light regulation functions

- Group 1 is the master for light regulation
- Groups 2, 3 and 4 can be enabled to follow group 1
- Individual offset can be set for group 2, 3 and 4 (typical requirement for classrooms)

Scene control

- Scenes can be stored with different light levels and color temperature for each group.

Pushbutton coupler support

- Scene recall
- Switching and dimming of up to four groups
- Switching/dimming and color temperature change of up to two groups

Sensor support

- Enable/disable a single sensor (light or motion), which affects all groups

3.2.3 Swarm feature

The Swarm feature enables a wireless communication between FLEX Control devices to share presence information. Only available in “**ExpertUser**” mode (see 4.2.2):

Use case 1: Multiple luminaire groups switch on together based on a wireless BT connection (without wired DALI connection!).

Use case 2: Basic brightness level in an open-plan office due to wireless standby activation.

3.3 Special features of FLEX CU RTC DALI-2 HCL TW

Additional out-of-the-box features compared to the non-RTC FLEX Control devices

- Switch/dim/change color temperature via connected pushbuttons
- Starts HCL curve after connecting with an app (DALI CONTROL APP is sufficient)


The real-time clock (RTC) with an energy buffer of 72 hours (needs 24 hours mains connection to be fully loaded) enables daytime-related functions such as:

- Human Centric Lighting (HCL)
- Timer (automatic, weekday and daytime-related start and stop of the light system)

3.3.1 Human Centric Lighting (HCL)

The standard HCL function includes:

- Automatic change of color temperature and brightness during daytime
- Preset HCL curve
- Easily adaptable HCL curve or pre-programmed BIOLUX HCL curves RELAX, BOOST, CREATE, NATURAL, FOCUS

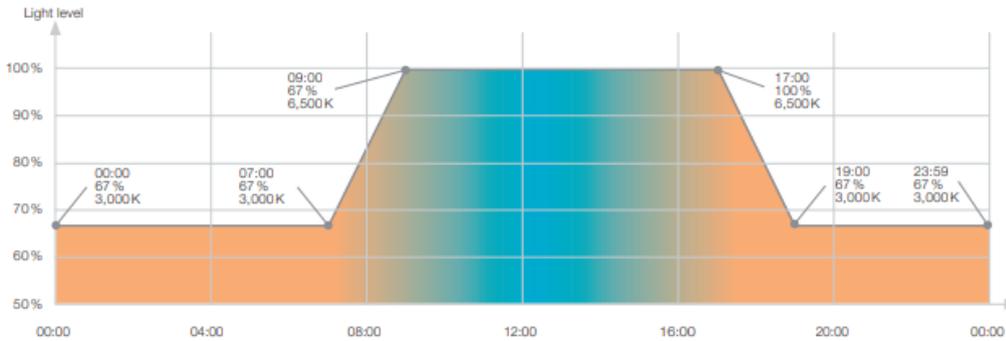

HCL will start automatically with default settings after synchronizing the real-time clock. Automatic sync done by connecting with the DALI CONFIG APP.


- The HCL curve can be easily adapted via the DALI CONFIG APP.
- Up to 24 points can be added or modified in the HCL curve.
- Each point consists of:
 - Daytime
 - Light level
 - Color temperature
- The fast-play button shows the HCL curve in a time lapse reducing the 24 hours to 72 seconds.
- Daylight harvesting with dynamic setpoint possible. Light regulation setpoint according to the HCL brightness curve.

3.3.2 Timer


The timer function includes up to four different timers.

Example with HCL function activated:

Timer 1: Days = Mon./Tue./Wed./Thu.; Time = 08:00 – 18:00

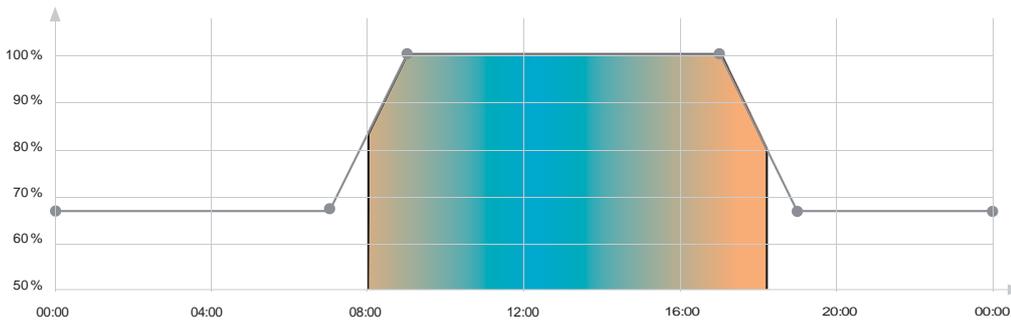

Timer 2: Days = Fri.; Time = 08:00 – 12:00

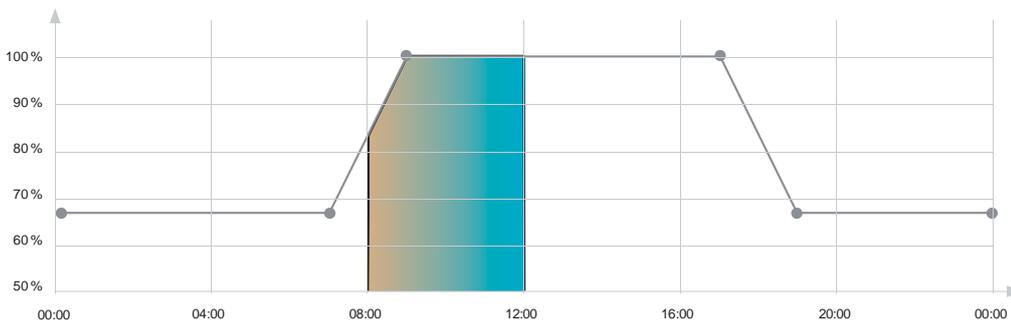

Up to four different timers can be activated to configure the devices to start and stop automatically.


- Each timer features:
 - Start time
 - Stop time
 - Weekdays (one or more weekdays can be chosen per timer)

BIOLUX HCL mode



There are 5 predefined HCL curves available which are selectable in DALI CONFIG APP.

The **NATURAL** curve can be seen as the “one fits all” solution.
But there are 4 further options to adapt the light as preferred.

- The LEDVANCE HCL system is giving the freedom to the user to select other lighting schemes like **Boost, Focus, Create, Relax** for any time of the day.
- The HCL-curves realized by LEDVANCE are respecting safety concerns in order to avoid inappropriate light in the evening and at night.
- False settings with potential health issues are excluded
- In Central Europe, there is one common time (CET), while the real local time differs by more than two hours from east to west.
- The LEDVANCE system is considering this automatically

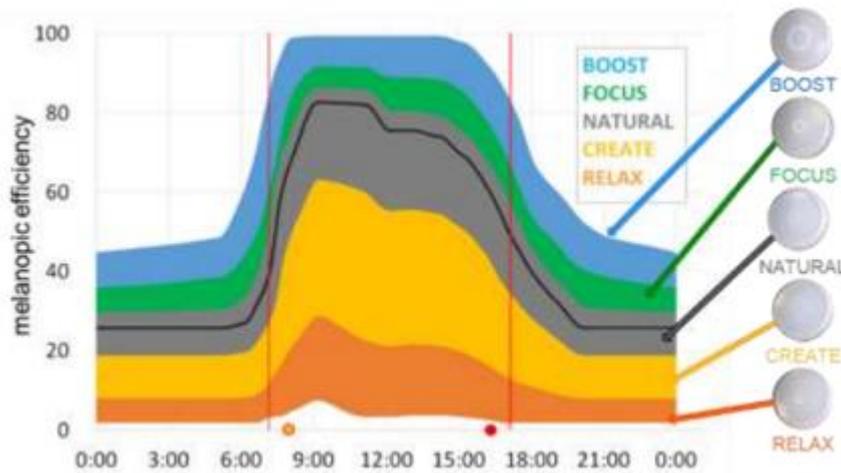


Dynamic of light is accurate for each day and any user location and can be adapted to specific user requirements.

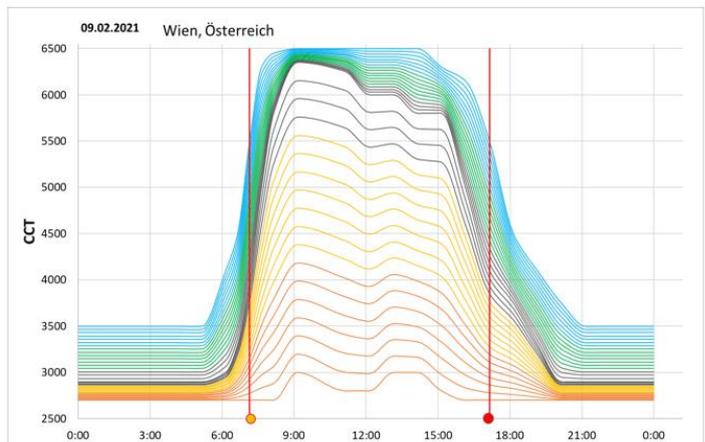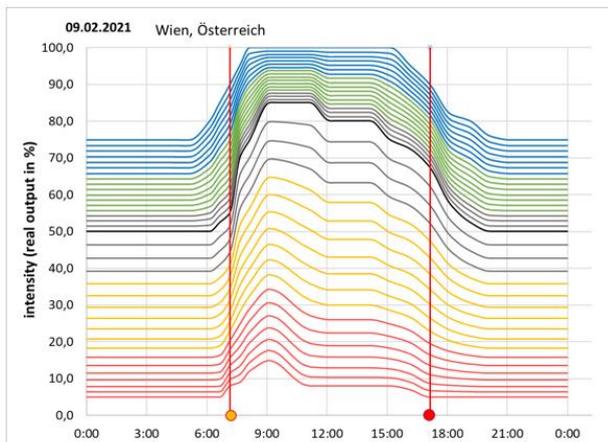

Light level for the different BIOLUX-Modes

Each main mode (RELAX ... BOOST) has 7 Submodes

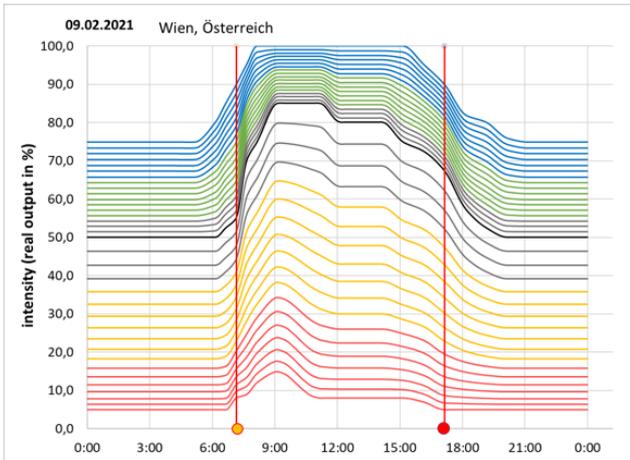

	Min (@ night) with Submode 1 4 7		Max (@ day) with Submode 1 4 7
RELAX	5 10 16		15 24 34
CREATE	18 26 36		38 50 63
NATURAL	39 50 54		68 85 88
FOCUS	56 60 64		89 92 95
BOOST	66 70 75		96 98 100


example: design level: 1000 lx
 @ night: RELAX, lowest level: 5% = 50 lx
 RELAX, highest level: 16% = 160 lx

3.4 Demo mode

Both Apps – DALI CONFIG APP and DALI CONTROL APP– provide a demo mode to simulate a connected device.



- Available for both apps (Control and configuration)
- It is no physical DALI control device required
- All 3 BT DALI control devices can be used
- Tunable White Control enabled by default
- Virtual sensor and coupler connected
- Group of 4 virtual luminaires enabled
- All settings can be adapted, stored as a custom profile and sent via email

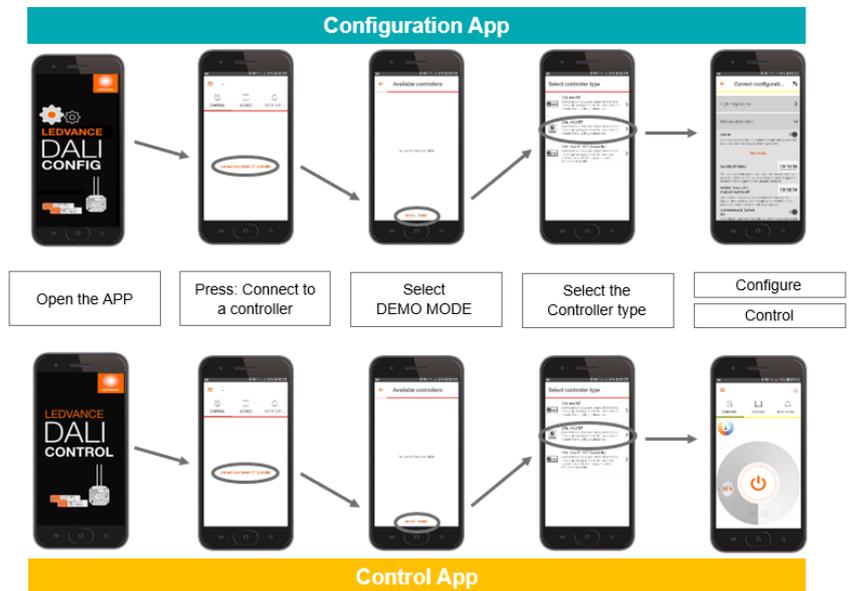

4 Configuration of multiple devices

4.1 Overview

Benefits

- Allows serial updating of up to 10 FLEX Control products (FLEX CU DALI-2 TW, FLEX CU DALI-2 TW RTC and FLEX CU FM DALI-2 TW are supported)
- Group addresses of drivers can be pre-programmed via T4T ¹⁾

Main user advantage


- In order to shorten luminaire production time, FLEX Control products can be pre-commissioned before assembling the luminaire.

Configurable features

- Firmware update
- Reset to factory new
- Synchronize RTC (FLEX CU DALI-2 TW RTC only)
- Set admin password
- Set user password
- Upload profile with custom settings

Please note:

This feature is only visible in Expert mode. For details, please see chapter 4.2.2.

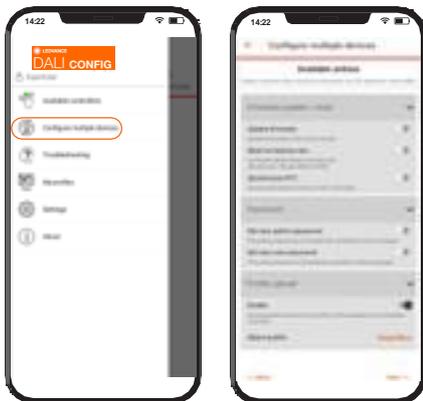

1) If the DALI driver with assigned group addresses is connected to the FLEX Control products, and the grouping function is already enabled, the lowest group address between 1-4 will be used (all other group addresses will be deleted).


4.2 Three steps for luminaire production with FLEX Control products



1 Configure the reference luminaire and save the profile.

2 Upload the profile to multiple FLEX Control devices.

3 Assemble the luminaires and perform all necessary function tests without the need of an app.

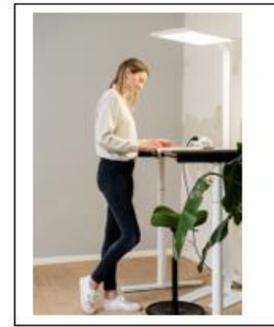


4.2.1 Step 1: Commissioning of a reference luminaire



The reference luminaire must be equipped with a FLEX CU DALI-2 product and the DALI CONFIG APP.

- 1 Connect the reference luminaire to the controller via Bluetooth.
- 2 Adapt the settings of the controller (actual configuration).
- 3 Adapt the pushbutton profiles.
- 4 Enable grouping (if needed).
- 5 Adapt the individual settings for each group (light regulation on/off, offset, switch-on level, scenes etc.).
- 6 Adapt the input device profiles.
- 7 Perform a light regulation calibration if light regulation is enabled.
- 8 Save all settings as a new profile.

4.2.2 Step 2: Upload the configuration to multiple FLEX Control products

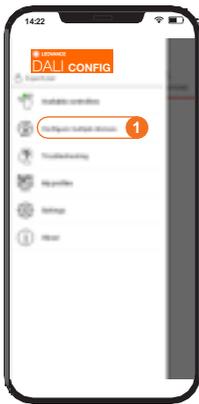

1 Open the app and select “Configure multiple devices” in the menu.

Please note:

- This feature is only visible in the Expert mode
- To enable the Expert mode, open “Settings” and “Profile”.

Please enter the following:

Name: **ExpertUser**
Company: **Ledvance**



2 Select available devices that shall be configured.

Please note:

- The app will be scanning for FLEX Control products via Bluetooth interface and will enable a one-to-one Bluetooth connection to download the information from each device.
- A device can be selected if the app has access to the controller.
- Factory-new devices have a 120-minute timer after power-up, before the access is blocked, as long as no password is set. **The remaining time is displayed next to the device (3).**
- If a device is password-protected and the password is stored in the app, it can be selected.
- If a device is locked via password (with another smart device), it must be unlocked by entering the password before it can be configured.

Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP **for two hours only (as long as no admin password is stored)**. After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.



Enable the actions that shall be performed

1 Update firmware:

- Always enable this feature to ensure that the latest firmware is uploaded to the device.

2 Reset to factory new:

- Only enable if you want to reset the configuration to “factory new”.

3 Synchronize RTC:

- Only valid for the FLEX CU DALI-2 TW RTC. If enabled, the date and time will be synchronized with the controller.
- If Human Centric Lighting (HCL) is enabled in the profile (default), the controller will use the brightness level and color temperature of the HCL profile when switched on.

4 Password:

- An admin and a user password can be set to limit the access to the controller via DALI CONFIG APP or DALI CONTROL APP.
- When an admin password is set, the 120-minute timer for access to the controller via DALI CONFIG APP is disabled.

5 Profile upload

- Any profile stored in the app can be uploaded to the device.

The profile includes:

- All settings included in the current configuration menu
- Active profile of the integrated pushbutton
- Setpoint for light regulation (if active and stored when the profile was saved) **Please note:** The controller will perform a calibration of the first setpoint for light regulation if active and stored.

Not stored in the profile:



Information of connected input devices (sensors, pushbutton couplers)

Important notes:

- Up to 10 FLEX Control devices can be configured in series.
- The devices can be powered via mains or alternatively via DALI.
- The progress of the configuration upload will be logged in the app.

Configuration status indicated via LED:

- Blue LED **on**: Smart device connected to the device (uploading)
- Blue LED **flashing slowly** (1 Hz): Upload successful
- Blue LED **flashing quickly** (2 Hz): Upload failed

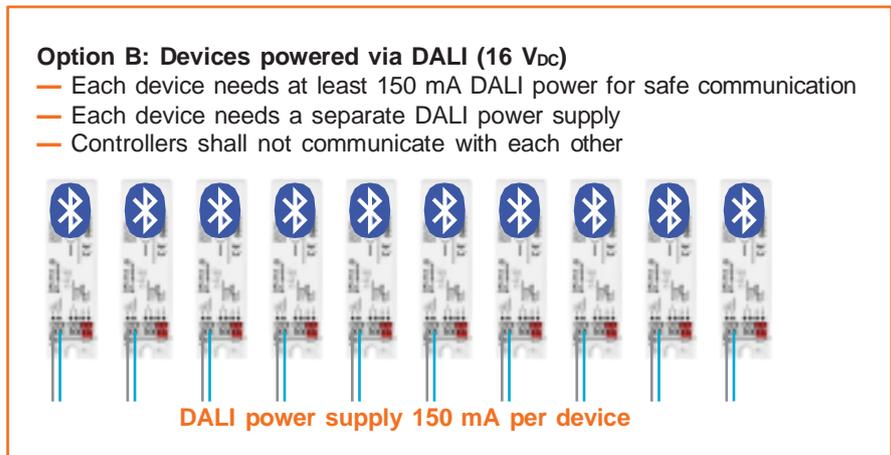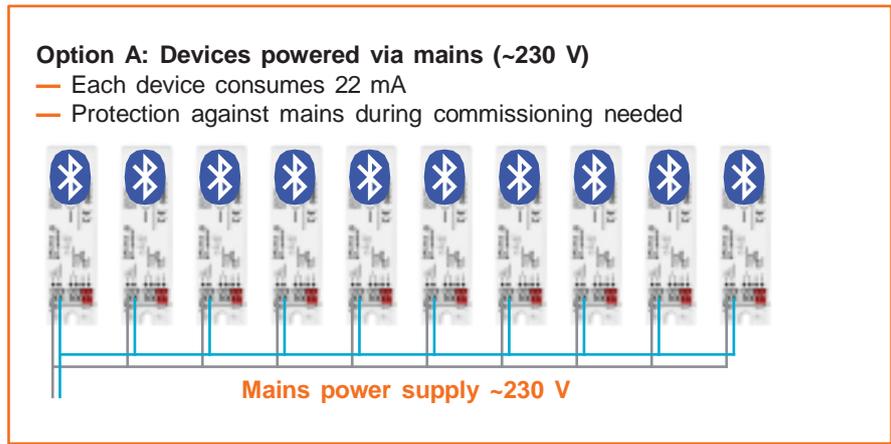

4.2.3 Step 3: Assembly of the luminaire in production

Just like other luminaire components, the pre-configured controller can be assembled without the need of a smart device for configuration during production.

Benefits for luminaires with integrated FLEX Control devices

- After assembling the luminaire, all functional and safety tests can be performed without the need of a smart device.
- No additional configuration step needed. **This saves a lot of time and effort.**

Benefits for luminaires with two groups (direct/indirect light): FLEX CU DALI-2 TW RTC

- Group addresses of DALI LED drivers can be pre-programmed, e.g. LEDVANCE DALI drivers can be programmed via Tuner4TRONIC (T4T) software.
- Internal pushbutton configuration already uploaded during step 2.
- After assembling the luminaire, all functional and safety tests can be performed without the need of a smart device (separate switching of direct/indirect light).
- The luminaire can be packed directly into the shipping box. **This saves a lot of time and effort.**

5 Applications and settings


Different applications have different functional demands and need different system settings. Here are some application use cases with the respective functional settings:

5.1 Stand-alone luminaire/s with integrated FLEX Control

Pendant, mounted or floor-standing luminaires with one (direct) or two (direct/indirect) light outputs

5.1.1 Floor-standing luminaire with 1 x DALI LED driver (with out-of-the-box light functions)

5.1.1.1 Requirements

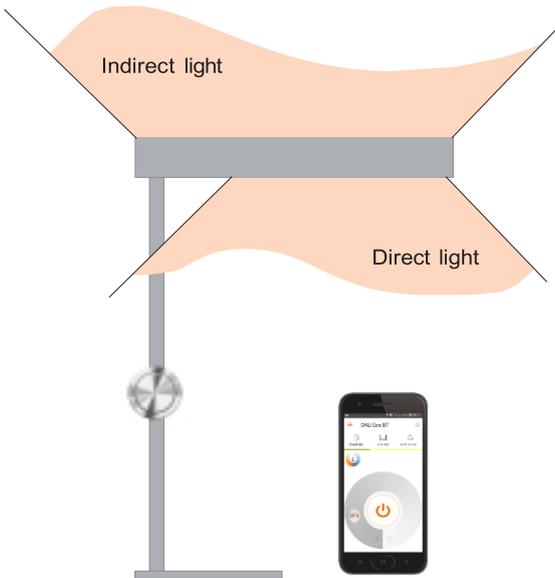


The floor-standing luminaire can be switched and dimmed with one pushbutton.

The integrated presence sensor automatically detects presence and turns the light on (and off again after a 15-minute delay time).

To keep the level at the sensor constant, the integrated light sensor dims the light up and down according to the amount of daylight.

The light can be switched on and off and dimmed via a smart device.

5.1.1.2 Product setup and wiring diagram

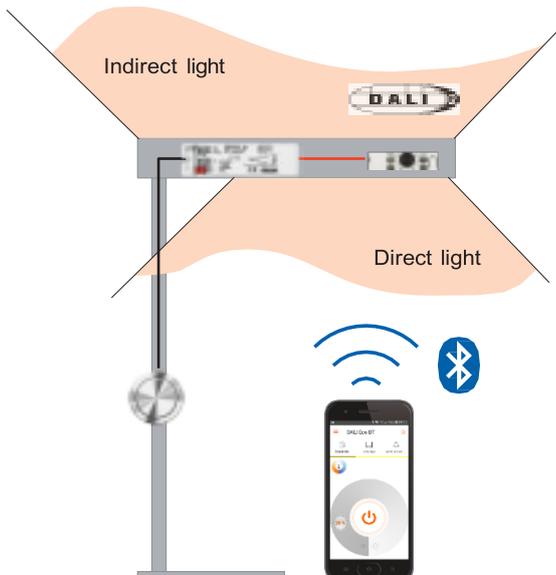


Solution with

1 x FLEX CU DALI-2 TW
Application controller

1 x DALI sensor
Light and presence sensor



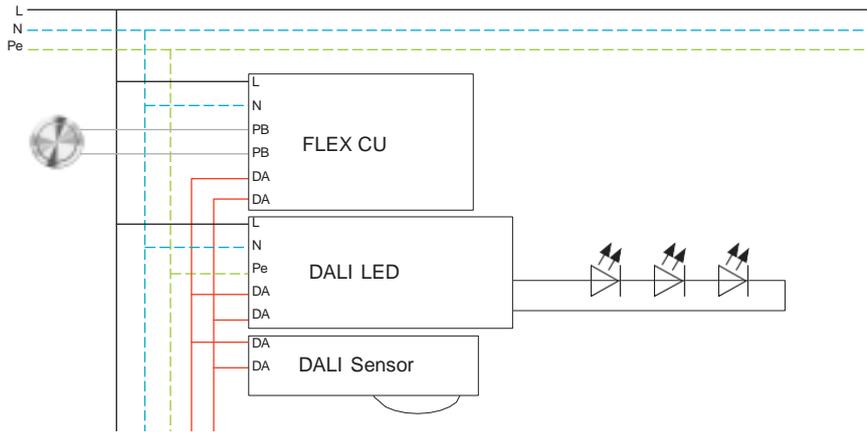

5.1.1.3 Out-of-the-box features (no app for configuration needed!)

Manual control via the connected pushbutton

- Short press: On/off
- Long press: Dim up/down
- Double press: Storing the actual light level as setpoint for DLHV (daylight harvesting)



Control via smartphone with the DALI CONTROL APP

- User can switch the light on/off and dim it via smartphone
- User can set a password to limit access



5.1.1.4 Additional configuration options via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG APP.

The DALI CONFIG APP configuration is not mandatory, but enables more flexibility to adapt the behavior to the customer requirements.



Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP for two hours only (as long as no admin password is stored). After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

Important note:

Save all settings as a profile and use the “Configure multiple devices” feature (see chapter 4) to upload the same settings on multiple FLEX Control products. This saves time during luminaire production.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.1.1.5 Password protection

When connecting to the DALI CONFIG APP for the first time, a window pops up where an admin password and the user password can be set.

If you want to add or change the password, follow steps below:



Set the admin/user password

- 1 Open the main menu.
- 2 Open "Settings".
- 3 Open "Password".
- 4 Enter an admin password to restrict the connection with the DALI CONFIG APP.

Please note: When the admin password is empty, you can only connect to the controller within two hours after connecting to mains. To reconnect after this time, you need to power-cycle the controller.



- 5 Enter a user password to restrict the connection with the DALI CONTROL APP.

- 6 Enable "Lock user password" to restrict the change of the user password via the DALI CONTROL APP.



5.1.1.6 Switch-off delay time

The switch-off delay is the time after which the controller will leave the "on-state". The switch-off delay timer is retriggered by each motion signal or manual user operation. The light will go **off** when no standby level is activated.



Change the switch-off delay time

- 1 Open the main menu.
 - 2 Open "Current configuration".
 - 3 Open "Motion detection" and go to "Switch off delay".
- Change the switch-off delay time according to your preferences.



5.1.1.7 Standby level and time

When activated, the light will go to the standby level after the switch-off delay time has expired. The light will switch **off** after the standby time has expired.



Activate the standby level and time

- 1 Open the main menu.
- 2 Open “Current configuration”.
- 3 Open “Advanced settings”.

Activate **standby level** and define the **standby level** and **standby time** according to your needs.



5.1.1.9 State after power failure

“State after power failure” defines the behavior of the connected DALI LED drivers after a power failure.



Change the state after power failure

- 1 Open the main menu.
- 2 Open “Current configuration”.
- 3 Open “Advanced settings” and go to “State after power failure”.

Change the **state after power failure** between **on/off/last state/standby** according to your needs.



5.1.1.8 PIR inhibit timer after manual switch-off



Activate the standby level and time

- 1 Open the main menu.
- 2 Open “Current configuration”.
- 3 Open “Motion detection”.

Change the **inhibit timer after manual switch-off**.


The timer starts when manually switched off via pushbutton or app. As long as the timer is active, the presence sensor will not switch on the light. Instead, it will retrigger the timer.



- Change the setting to 01:00:00 to be sure that the light will not switch on automatically when you come back from a lunch break.
- Leave it at 00:00:30 sec if you want the automatic switch-on to be active again after you have left the room.

5.1.2 Floor-standing luminaire with 2 x DALI drivers separating the direct and indirect light

5.1.2.1 Requirements

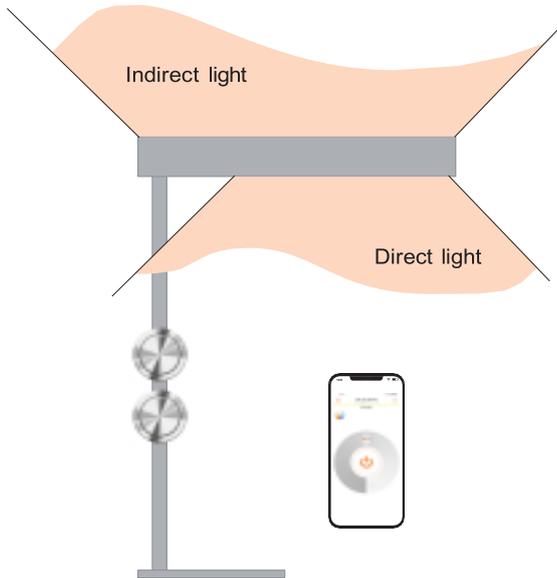


The floor-standing luminaire can be switched and dimmed with two pushbuttons.

The integrated presence sensor automatically detects presence and turns the light on (and off again after a 15-minute delay time).

Daylight harvesting should be active for the direct light and a constant light level should be active for the indirect light. To keep the level at the sensor constant, the integrated light sensor dims the light up and down according to the amount of daylight for the direct light output only.

The two light outputs can be switched and dimmed separately via a smart device.

5.1.2.2 Product setup and wiring diagram FLEX CU DALI-2 TW RTC with resistor

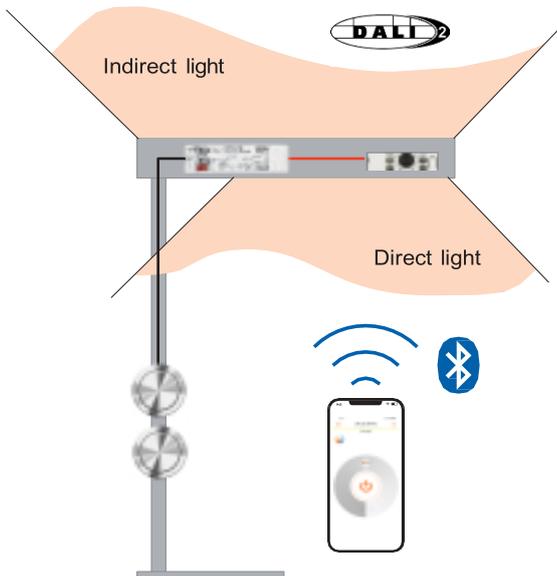


Solution with FLEX CU DALI-2 TW RTC

1 x FLEX CU DALI-2 TW RTC
Application controller



1 x DALI sensor
Light and presence sensor



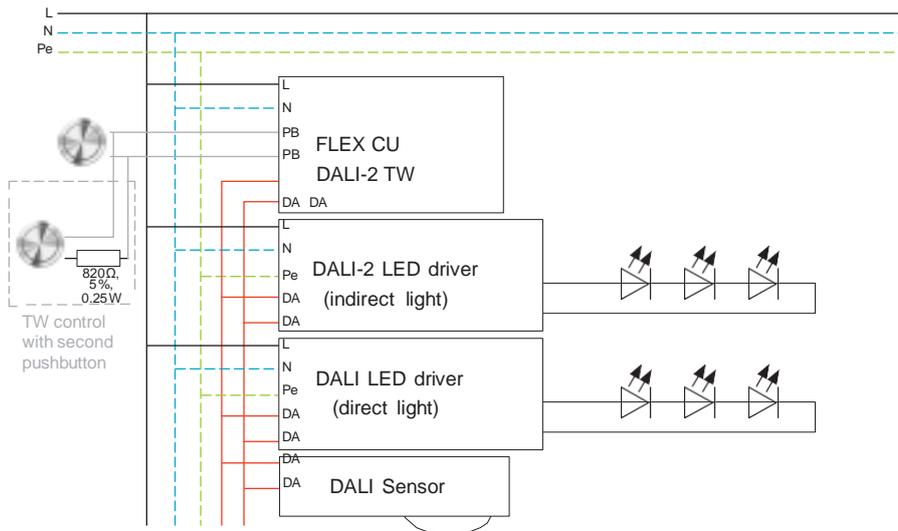

5.1.2.3 Out-of-the-box features (no app for configuration needed!)

Attention: For this application, the out-of-the-box features are **not** sufficient.

Additional configuration via the **DALI CONFIG APP** is required (see chapter 5.1.2.3 ff.)!

5.1.2.4 Configuration via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG

APP. The DALI CONFIG APP configuration is **mandatory** for this

application!

The grouping feature needs to be activated, the HCL function needs to be de-activated, and the two pushbuttons need to be configured as well.

Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP **for two hours only (if no admin password is stored)**. After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.1.2.5 Password protection

Please see 4.1.1.5: Password protection

5.1.2.6 Grouping

Grouping is necessary as a differentiation between the direct and indirect light output is wanted. After the grouping process is finished, the light/s assigned to one group can be controlled separately from the other group/s.



Group the luminaires

- Open the main menu.
- Open “Grouping” in the main menu.
- Start the addressing procedure by selecting “Activate Grouping”.
- All found LED drivers will be listed and automatically assigned to Group 1.



After selecting one device, the connected luminaire starts flashing.

- After selecting the group number, the number changes 1-2-3-4-1 ..., as up to four groups can be configured.

Group 1 = Direct light
Group 2 = Indirect light



5.1.2.7 Daylight harvesting (DLHV)

The daylight harvesting function is automatically activated when a corresponding daylight sensor is connected. As only the direct light (Group 1) will use this light regulation, the indirect light (Group 2) needs to be disabled:



Activate the light regulation

- Go back to the main menu.
- Open “Current configuration”.
- Open “Light regulation”.
- Define the required light level by choosing “Set Automatically” or “Manual”.
- Disable “Group 2 Light Regulation” as Group 2 (indirect light) should always stay at the same light level.



5.1.2.8 Pushbutton configuration

The out-of-the-box (default) behavior of the pushbutton is controlling all light groups at the same time. An independent control of different groups must be adapted accordingly:



Set the pushbutton configuration

- Open the **main menu**.
- Open “Current configuration”.
- Open “Push Button Setting”.
- Click on “**Configure**” for the “Push button behavior”.
- Open the “Integrated Push Button”.
- Click on “**Profile**” and **choose** the respective profile for Group 1: On/off/dim
Group 2: On/off/dim



5.1.2.9 HCL deactivation

The out-of-the-box function package of the FLEX CU DALI-2 TW RTC includes an automatic activation of the Human Centric Lighting (HCL) function as soon as the DALI CONTROL APP is connected. The automatic HCL function will override the DLHV function. In order to use daylight harvesting as intended in this application example for direct light (group1), it is therefore necessary to deactivate the HCL beforehand.



Deactivate the HCL function

1. Open the **main menu**.
2. Open “Current configuration” in the main menu.
3. Open “Human Centric Lighting”.
4. “**Disable HCL**” in the **Status** menu.




Important note:

Save all settings as a profile and use the “Configure multiple devices” feature (see chapter 4) to upload the same settings on multiple FLEX Control products. This saves time during luminaire production.

- Internal pushbutton settings will be stored in the profile.
- Group addresses of LED drivers can be pre-programmed to save time during luminaire production.

5.1.3 Floor-standing luminaire with 1 x DALI LED driver and active HCL function

5.1.3.1 Requirements

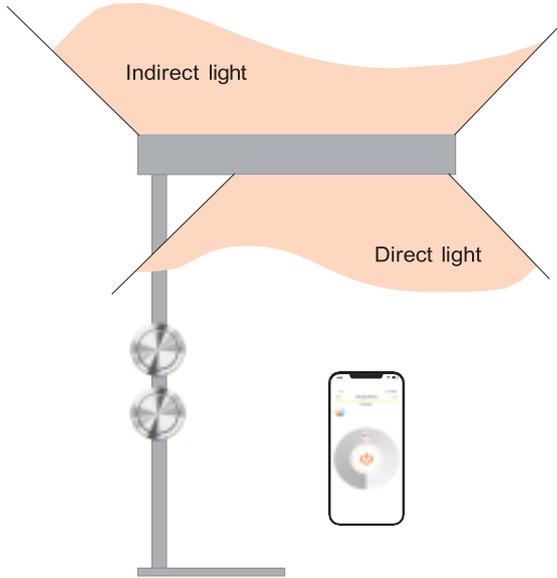


The floor-standing luminaire can be switched, dimmed and tuned (Tunable White) with two pushbuttons.

The integrated presence sensor automatically detects presence and turns the light on (and off again after a 15-minute delay time).

HCL (Human Centric Light) should be active based on a pre-defined daylight curve for artificial daylight simulation running during business hours while presence is detected.

5.1.3.2 Product setup and wiring diagram FLEX CU DALI-2 TW RTC with resistor

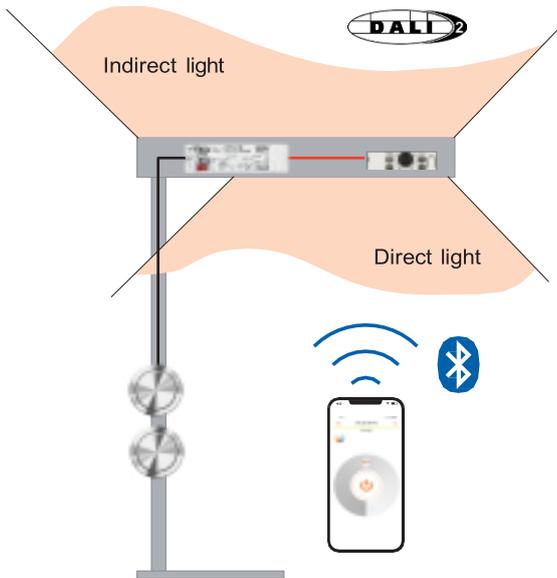


Solution with FLEX CU DALI-2 TW RTC

1 x FLEX CU DALI-2 TW RTC
Application controller



1 x DALI-2 sensor
Light and presence sensor

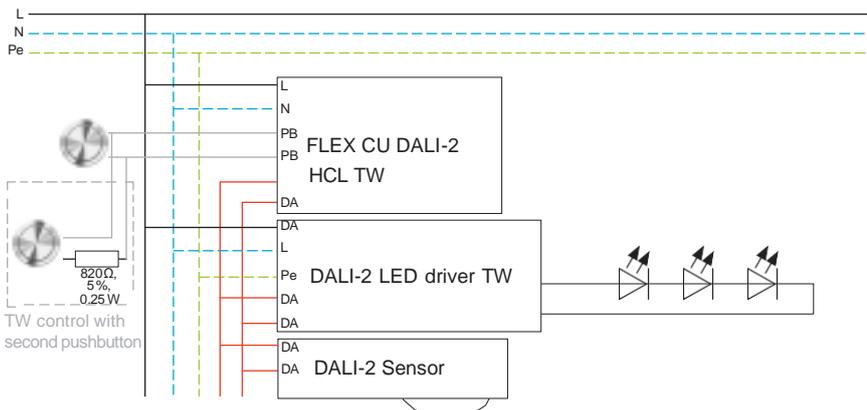

5.1.3.3 Out-of-the-box features (no app for configuration needed!)

Manual control via two directly connected pushbuttons

Button 1:

- Short press: On/off
- Long press: Dim up/down



Button 2 (with resistor):

- Short press: Scene toggle
- Long press: Tune cold/warm (Tunable White)



Control via smartphone with the DALI CONTROL APP

- By connecting the Control App and synchronizing the RTC (real-time clock) in the FLEX CU DALI-2 TW RTC, the user **automatically starts the HCL function**, which is based on a pre-defined light curve.
- The user can switch and dim the light via smartphone.
- The user can tune the light via smartphone (Tunable White).
- The user can set a password to limit access.



5.1.3.4 Additional configuration options via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG APP.

For using the HCL function, the DALI CONFIG APP configuration is not mandatory, but enables more flexibility to adapt the behavior to the requirements of the customer.



Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP **for two hours only (if no admin password is stored)**. After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.1.3.5 Password protection


Please see 5.1.1.5: Password protection

5.1.3.6 HCL activation and adaptation

The firmware of the FLEX CU DALI-2 TW RTC Control device consists of a pre-defined HCL curve, which can be automatically started by connecting the DALI CONTROL APP, including automatic synchronization of the real-time clock. If the pre-defined light curve does not fit to the customer requirements, the curve can be easily adapted and stored as a new HCL curve.

Important note:


After activation of the **HCL function, the light curve brightness points are active!** This means that if the DLHV (daylight harvesting) function is active at the same time, the HCL curve is in the lead and **HCL will override DLHV** (see chapter 4.1.2.7).

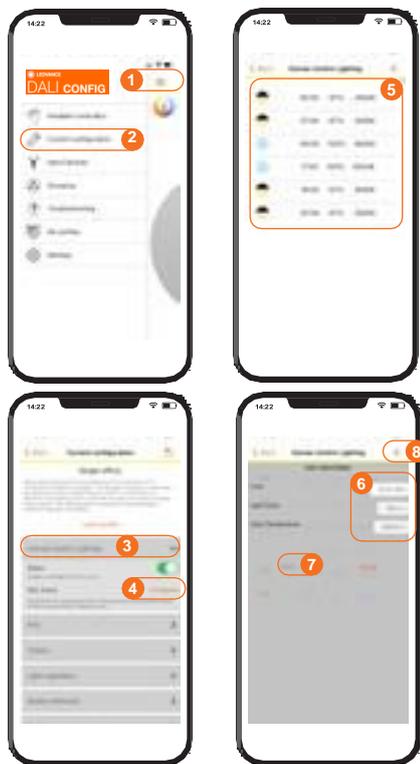

Activate the HCL function

1. Open the main menu.
2. Open “Current configuration” in the main menu.
3. Open “Human Centric Lighting” and “Enable HCL”, which starts a pre-programmed HCL curve.
4. If needed, “configure” the HCL curve according to the application needs.
5. Click on any of the available light curve points for modification.
6. “Time”, “Light Level” and “Color Temperature” can be configured.
7. If changes have been made, please click on “Save”.
8. To insert additional light curve points, please click on the “+”.

This diagram shows the pre-programmed HCL light curve:

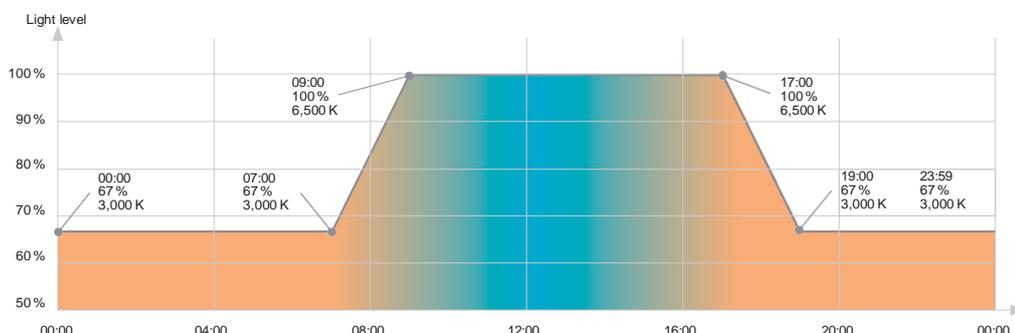

Important note:


Save all settings as a profile and use the “Configure multiple devices” feature (see chapter 4) to upload the same settings on multiple FLEX Control products. This saves time during luminaire production.

5.2 Single-room applications with integrated FLEX Control device

Single office, open-plan office, corridor or classroom applications with automatic sensor control and/or manual pushbutton control for pendant, mounted or floor-standing luminaires with one (direct) or two (direct/indirect) light outputs.

5.2.1 Single office (with out-of-the-box light functions)

5.2.1.1 Requirements

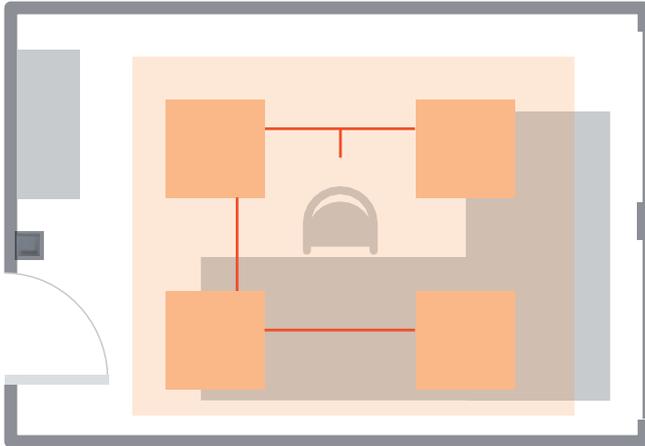


The office luminaires can be switched and dimmed with one pushbutton.

The integrated presence sensor automatically detects presence and turns the light on (and off again after a 15-minute delay time).

During presence, the daylight harvesting function will dim the artificial light up and down according to the amount of daylight available.

5.2.1.2 Application setup and wiring diagram

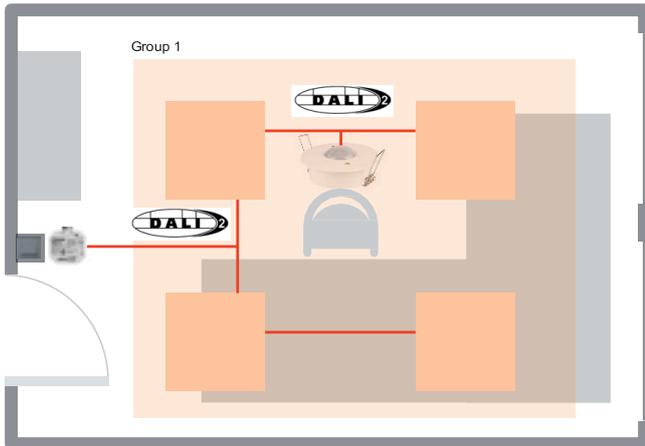

Solution with FLEX CU FM DALI-2 TW

4 x standard DALI-2 luminaires




1 x DALI-2 sensor

Light and presence detector for ceiling integration



1 x FLEX CU FM DALI-2 TW

DALI-2 controller (in flush-mounted box)

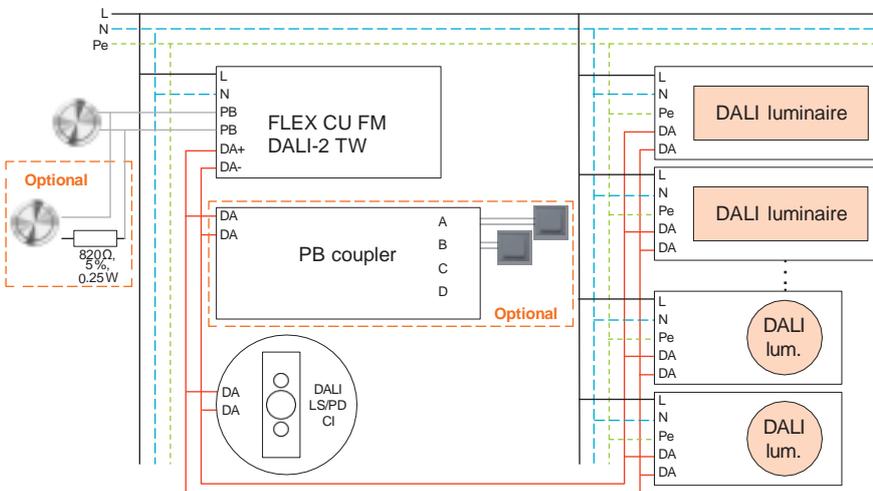

5.2.1.3 Out-of-the-box features (no app for configuration needed!)

Manual control via the connected pushbutton:

- Short press: On/off
- Long press: Dim up/down
- Double press: Storing the actual light level as set point for DLHV (daylight harvesting)



Optional: Second pushbutton (with resistor):

- Short press: Scene toggle
- Long press: Tune cold/warm (Tunable White)



Optional: Pushbutton coupler:



Name	Function of input A	Function of input B	Function of input C	Function of input D
1: 1-channel Tunable White (default)	SP: Switch on/off LP: Dim up/down Groups: All (1-4)	SP: Toggle scene LP: Change color temp. Groups: All (1-4)	SP: Recall scene 1 LP: --- Groups: All (1-4)	SP: Recall scene 2 LP: --- Groups: All (1-4)

* SP = Short press

** LP = Long press

Control via smartphone with the DALI CONTROL APP

- The user can switch and dim the light via smartphone.
- The user can tune the light via smartphone (Tunable White).
- The user can set a password to limit access.



5.2.1.4 Additional configuration options via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG APP.

The DALI CONFIG APP configuration is not mandatory but enables more flexibility to adapt the behavior to the requirements of the customer.



Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP **for two hours only (as long as no admin password is stored)**. After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.2.1.5 Password protection

When connecting to the DALI CONFIG APP for the first time, a window pops up where an admin password and the user password can be set.

If you want to add or change the password, follow the steps below:



Set the admin/user password

1. Open the main menu.
2. Open "Settings".



3. Open "Password".



4. Enter an admin password to restrict the connection with the DALI CONFIG APP.

Please note: When the admin password is empty, you can only connect to the controller within two hours after connecting to mains. To reconnect after this time, you need to power-cycle the controller.

5. Enter a user password to restrict the connection with the DALI CONTROL APP.

6. Enable "Lock user password" to restrict the change of the user password via the DALI CONTROL APP.

5.2.1.6 Switch-off delay time

The switch-off delay is the time after which the controller will leave the "on-state". The switch-off delay timer is retriggered by each motion signal or manual user operation. The light will go **off** when no standby level is activated.



Change the switch-off delay time

1. Open the main menu.
2. Open "Current configuration".



3. Open "Motion detection".

Change the switch-off delay time according to your preferences.

5.2.1.7 Standby level and time

When activated, the light will go to the standby level after the switch-off delay time has expired. The light will switch **off** after the standby time has expired.




Activate the standby level and time

1. Open the main menu.
2. Open “Current configuration”.
3. Open “Advanced settings”.

Activate standby level and define the standby level and standby time according to your needs.



5.2.1.8 PIR inhibit timer after manual switch-off

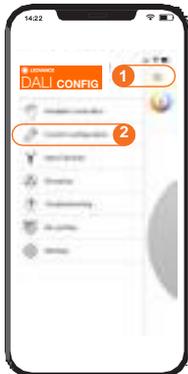

Change the PIR inhibit timer

1. Open the main menu.
2. Open “Current configuration”.
3. Open “Motion detection”.

Change the inhibit timer after manual switch-off.

The timer starts when manually switched off via pushbutton or app. As long as the timer is active, the presence sensor will not switch on the light. Instead, it will retrigger the timer.

- Change the setting to 01:00:00 to be sure that the light will not switch on automatically when you come back.
- Leave it at 00:00:30 sec if you want the automatic switch-on to be active again after you have left the room.



5.2.1.9 Manual setting of light regulation

Depending on the availability of natural daylight and the room setup, the light regulation value might need to be set manually – instead of automatically – to get the right amount of light according to customer needs.



Manual setting of light regulation

1. Open the main menu.
2. Open “Current configuration”.
3. Now open the “Light regulation”.

4. Click on “Manual” to define the required light level manually.

5. Dim the light to the required level and use a lux meter to measure the amount of light directly at the place where the light is needed, e.g. a desk surface.

6. Click on “Save” to store the light level as a reference value for light regulation.



5.2.1.10 State after power failure

“State after power failure” defines the behavior of the connected DALI LED drivers after a power failure.



Change the state after power failure


1. Open the main menu.
2. Open “Current configuration”.
3. Open “Advanced settings”.

Change the state after power failure between **on/off/last state/standby** according to your needs.



5.2.2 Meeting room with scene control

5.2.2.1 Requirements

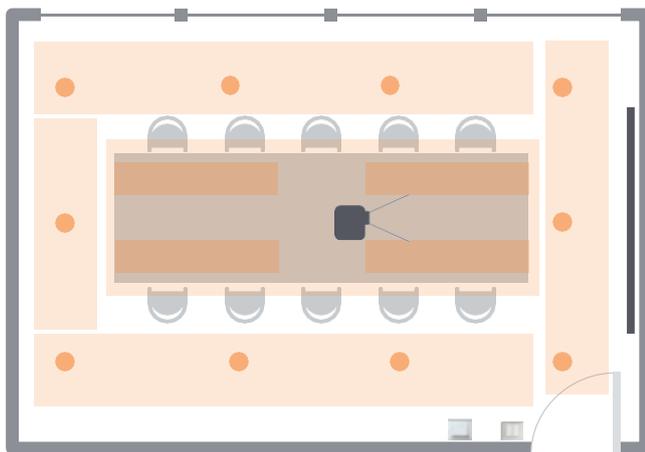


The meeting room luminaires can be switched and dimmed and pre-configured. Light scenes can be recalled by using pushbuttons.

The light will be switched on manually when a person enters the room, but automatically turned off by the sensor after a 15-minute delay time.

During presence, the daylight harvesting function will dim the artificial light up and down according to the amount of daylight available.

5.2.2.2 Application setup and wiring diagram

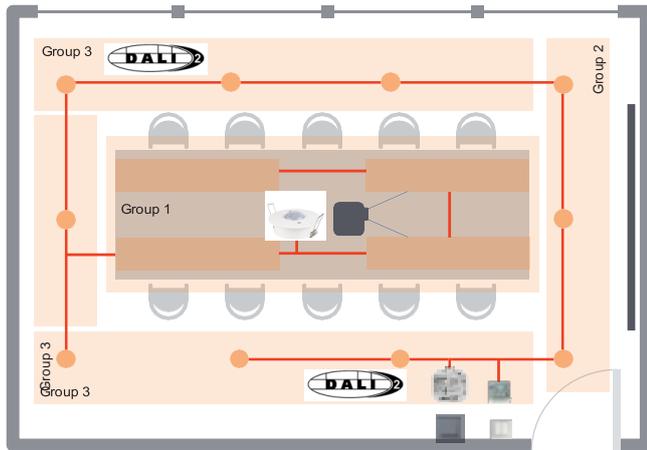

Solution with


FLEX CU FM DALI-2 TW

1 x DALI-2 sensor
Light and presence detector for ceiling integration

Standard DALI-2 luminaires
4 x Panels
10 x Downlights

1 x FLEX CU FM DALI-2 TW
DALI controller (best mounted in a flush box)

1 x DALI-2 PB coupler

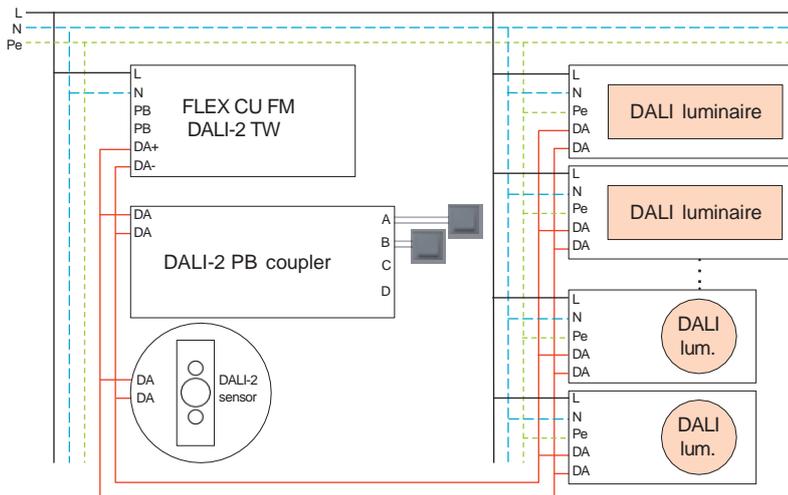

5.2.2.3 Out-of-the-box features (no app for configuration needed!)

Pushbutton coupler



Name	Function of input A	Function of input B	Function of input C	Function of input D
1: 1-channel Tunable White (default)	SP: Switch on/off LP: Dim up/down Groups: All (1-4)	SP: Toggle scene LP: Change color temp. Groups: All (1-4)	SP: Recall scene 1 LP: --- Groups: All (1-4)	SP: Recall scene 2 LP: --- Groups: All (1-4)

* SP = Short press

** LP = Long press

Control via smartphone with the DALI CONTROL APP

- The user can switch and dim the light via smartphone.
- The user can set a password to limit access.



4.2.2.4 Additional configuration options via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG APP.

The DALI CONFIG APP configuration is not mandatory but enables more flexibility to adapt the behavior to the requirements of the customer.



Important note

After powering up the controller, it can be configured with the DALI CONFIG APP for two hours only (as long as no admin password is stored). After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.2.2.5 Password protection

Please see 5.2.1.5: Password protection


5.2.2.6 Change of default setup

The default setup of the control unit is the “Single Office” mode, which needs to be changed to the “Meeting Room” mode first.



Change of default setup

1. Open the main menu.
2. Open “Current configuration”.
3. The “Single office” profile is activated by default.
4. Click on “Load a profile”.
5. Select the “Meeting room” profile and click on “OK” to save this change of configuration.

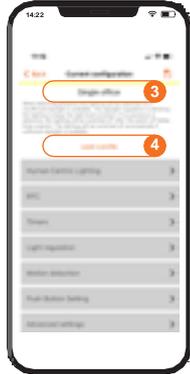

5.2.2.7 Grouping

According to the meeting room requirements, the luminaires need to be grouped to realize the setup for two different light scenes: “Meeting” and “Presentation”.



Group the luminaires

1. Open the main menu.
2. Open “Grouping” in the main menu.
3. Start the addressing procedure by selecting “Activate Grouping”.
4. All found LED drivers will be listed and automatically assigned to group 1.

After selecting one device, the connected luminaire starts flashing.



5. After selecting the group number, the number changes 1-2-3-4-1 ..., as up to four groups can be configured.

- Group 1 = Table light
- Group 2 = Projector wall light
- Group 3 = Surrounding light



5.2.2.8 Scene creation

The meeting room light should be able to change just by clicking on a pushbutton, based on two different lighting scenarios: "Meeting" and "Presentation".

Scene 1: Meeting

- Recall via pushbutton
- Light level group1: 80 %
- Light level group2: 50 %
- Light level group3: 50 %

Scene 2: Presentation

- Recall via pushbutton
- Light level group1: 50 %
- Light level group2: 0 %
- Light level group3: 30 %



Create the scenes

Go to the **control menu** and start with **scene 1**:

1. Click on "Group 1" and dim the light to the required level (group 1 = 80 %).

Repeat this step for "Group 2" (50 %) and "Group 3" (50 %).


2. Click on the "star" to save this scenario as scene 1 = "Meeting" for group 1 (80 %), group 2 (50 %) and group 3 (50 %).

Repeat these steps for "Scene 2" = Presentation

3. Open the scene menu to activate the stored scenes or press the buttons 3 and 4 on the pushbutton coupler.

5.2.3 Classroom with daylight harvesting (DLHV) plus light group offset

5.2.3.1 Requirements

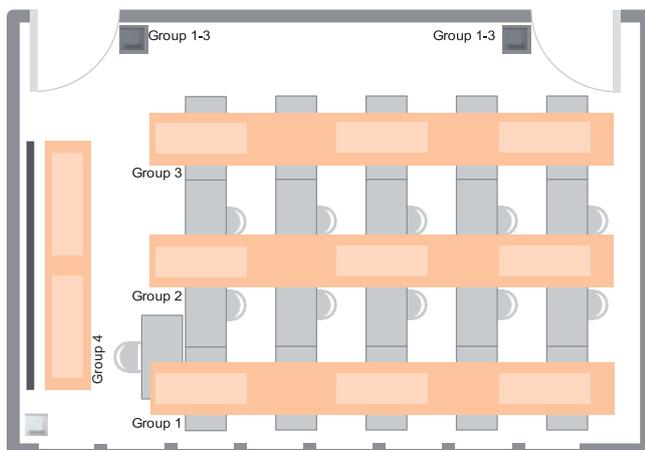


The classroom luminaires are divided into four light groups. Group 4 (presentation board) can be switched and dimmed separately.

The lights will be switched on manually when a person enters the room, but automatically turned off after a 15-minute delay time if no presence is detected.

During presence, the daylight harvesting function will dim the artificial light up and down according to the amount of daylight available.

5.2.3.2 Application setup and wiring diagram

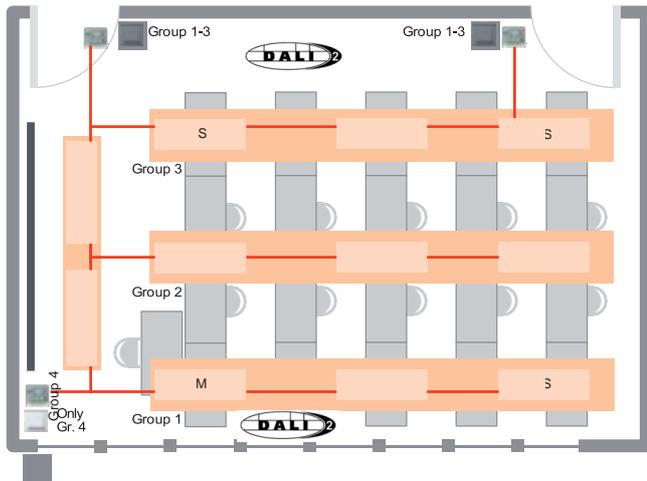

Solution with

FLEX CU DALI-2 TW



3 x DALI-2 PB coupler



7 x standard DALI-2 luminaires




M = Master luminaire

1 x DALI luminaire with integrated FLEX CU DALI-2 TW Control device and DALI sensor



S = Sensor luminaire

3 x DALI luminaire with integrated DALI-2 sensor

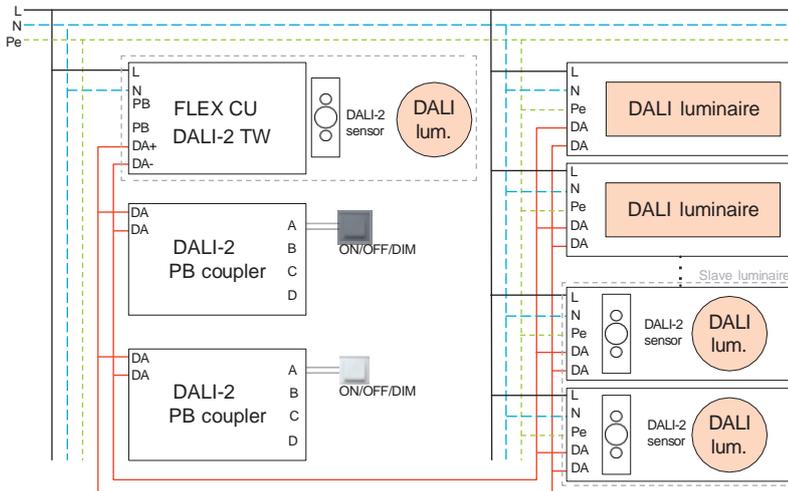

5.2.3.3 Out-of-the-box features (no app for configuration needed!)

Attention: For this application, the out-of-the-box features are **not** sufficient.

Additional configuration via the **DALI CONFIG APP** is required (see chapter 5.2.3.4 ff.)!

5.2.3.4 Configuration via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG

APP. The DALI CONFIG APP configuration is **mandatory** for this application!



The grouping feature needs to be activated, the HCL function needs to be de-activated, and the two pushbuttons need to be configured as well.

Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP **for two hours only (as long as no admin password is stored)**. After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.2.3.5 Password protection

Please see 5.2.1.5: Password protection

5.2.3.6 Activation of semi-automatic mode (manually on, automatically off)



Activation of semi-automatic mode

1. Open the main menu.
2. Open "Current configuration".
3. Open "Motion detection".
4. Move the "Automatically Switch On" slider to off.

The presence sensor will not switch on the light automatically while detecting presence, the light needs to be switched on manually via the pushbutton.



5.2.3.7 Grouping

According to the classroom requirements, the luminaires need to be grouped to realize the four different light groups.



Group the luminaires

1. Open the main menu.
2. Open "Grouping" in the main menu.
3. Start the addressing procedure by selecting "Activate Grouping".
4. All found LED drivers will be listed and automatically assigned to group 1.

After selecting a device, the connected luminaire starts flashing.

5. After selecting the group number, the number changes 1-2-3-4-1 ..., as up to four groups can be configured.

- Group 1 = Window row light
- Group 2 = Center row light
- Group 3 = Inner row light
- Group 4 = Presentation board light



5.2.3.8 DLHV function with defined light group offset

Depending on the availability of natural daylight and the room setup, the light regulation provides the right amount of light according to the needs of the customer. As the DLHV function is dedicated to group 1 only, the other light groups – group 2 and group 3 – must be run with a defined offset compared to group 1 to guarantee an equal light distribution throughout the room.



Define the light group offset

1. Open the main menu.
2. Open “Current configuration”.
3. Now open the “Light regulation”.
4. Activate the “Group 2 Light Regulation” and define the “Offset” according to room requirements.

Repeat step 4 for the “Group 3 Light Regulation” setup.

5.2.3.9 Change of pushbutton coupler (PBC) setting for group 4 (presentation board)

The default setup of all PBCs is “1: 1-channel Tunable White”. As only **group 4 (presentation board)** has a dedicated pushbutton for separate control, only the dedicated PBC setup needs to be changed to “4: 4-channel dimming”. The pushbutton needs to be connected to **input D** on the dedicated PBC.

Name	Function of Input A	Function of Input B	Function of Input C	Function of Input D
1: 1-ch tunable white (Default)	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>	SP: Toggle Scenes LP: Change Color Temp <i>Groups: All (1-4)</i>	SP: Recall Scene 1 LP: --- <i>Groups: All (1-4)</i>	SP: Recall Scene 2 LP: --- <i>Groups: All (1-4)</i>
2: 2-ch tunable white	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 1</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 2</i>	SP: --- LP: Change Color Temp <i>Group: 1</i>	SP: --- LP: Change Color Temp <i>Group: 2</i>
3: 2-ch dimming	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 1</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 2</i>	SP: ON LP: --- <i>Groups: All (1-4)</i>	SP: OFF LP: --- <i>Groups: All (1-4)</i>
4: 4-ch dimming	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 1</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 2</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 3</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Group: 4</i>
5: Scene control	SP: Recall Scene 1 LP: --- <i>Groups: All (1-4)</i>	SP: Recall Scene 2 LP: --- <i>Groups: All (1-4)</i>	SP: Recall Scene 3 LP: --- <i>Groups: All (1-4)</i>	SP: Recall Scene 4 LP: --- <i>Groups: All (1-4)</i>
6: 1 Light regulation	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Groups: All with active LR</i>	SP: Resume LR LP: --- <i>Groups: All with active LR</i>	SP: OFF LP: --- <i>Groups: All (1-4)</i>	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>
7: TW & HCL Broadcast	SP: Switch ON / OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>	SP: Toggle Scenes LP: Change Color Temp <i>Groups: All (1-4)</i>	SP: Recall Scene 1 LP: --- <i>Groups: All (1-4)</i>	SP: HCL Resume LP: --- <i>Groups: All (1-4)</i>
8: BIOLUX	SP: HCL-1 ON / OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>	SP: --- LP: Change Color Temp <i>Groups: All (1-4)</i>	SP: HCL-2 ON/OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>	SP: HCL-3 ON/OFF LP: DIM UP/DOWN <i>Groups: All (1-4)</i>

¹⁾ HCL only applicable with FLEX CU DALI-2 TW RTC Control device

^{*} SP = Short press

^{**} LP = Long press




Change of default setup for group 4

1. Open the main menu.
2. Open “Current configuration”.
3. Open “Push Button Setting” and click on “Configure” for the “Push Button Coupler”.
4. Please identify the dedicated PBC of group 4 by **pressing** the **connected pushbutton**.
5. Select the “4. DIM – 4 groups” profile and **click on “Done”** to save this change of configuration.



5.2.4 Corridor including standby (infinite timer)



5.2.4.1 Requirements

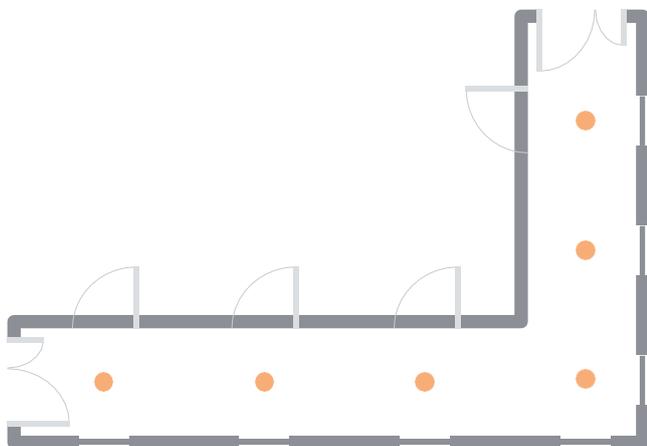

The lights will be switched on automatically when a person enters the corridor and automatically dimmed down to a light level of 10 % after the delay time has expired and if no presence is detected.

The light will stay on and never switch off due to safety requirements, so the standby time is infinite.

5.2.4.2 Application setup and wiring diagram

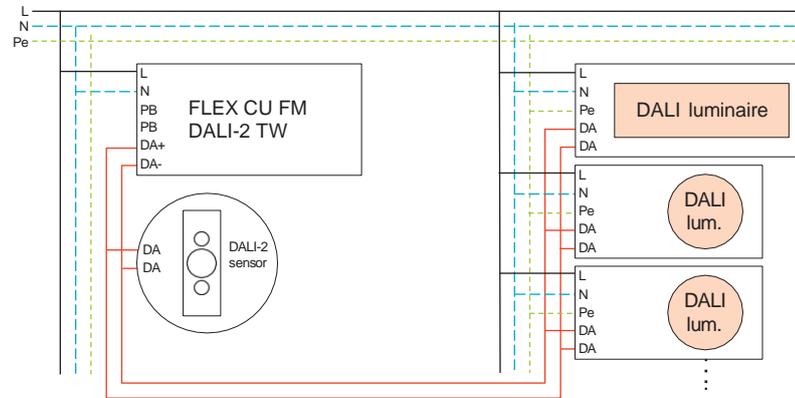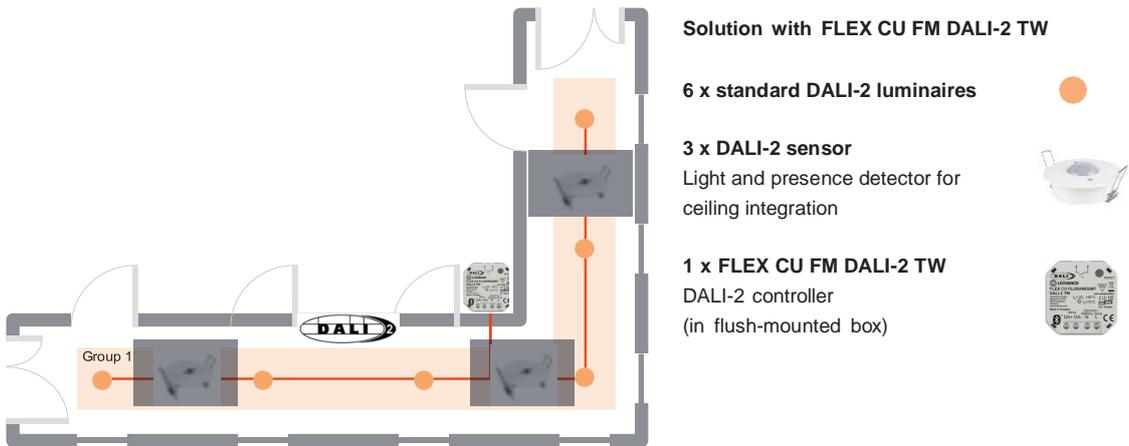

5.2.4.3 Out-of-the-box features (no app for configuration needed!)

Attention: For this application, the out-of-the-box features are **not** sufficient.

Additional configuration via the **DALI CONFIG APP** is required (see chapter 5.2.3.4 ff.)!

5.2.4.4 Configuration via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG APP.

The DALI CONFIG APP configuration is **mandatory** for this application!

The grouping feature needs to be activated, the HCL function needs to be deactivated, and the two pushbuttons need to be configured as well.



Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP for **two hours only (if no admin password is stored)**. After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.2.4.5 Password protection

Please see 5.2.1.5: Password protection


5.2.4.6 Change of default setup

The default setup of the control unit is the “Single Office” mode, which needs to be changed to the “Corridor” mode first.



Change of default setup

1. Open the main menu.
2. Open “Current configuration”.
3. The “Single office” profile is activated by default.
4. Click on “Load a profile”.
5. Select the “Corridor” profile and click on “OK” to save this change of configuration.

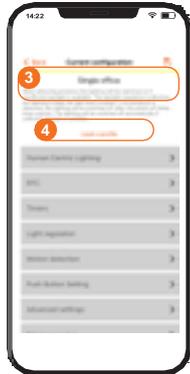

5.2.4.7 Standby level and time

When the “Corridor” mode is activated (see chapter 5.2.4.6), the light will go to the pre-defined standby level of 10 % after the switch-off delay time has expired. The light will never switch off as the standby time is infinite.



Choose the standby level


1. Open the main menu.
2. Open “Current configuration”.
3. Open “Advanced settings”.

Choose the required “Standby level”. The default level in “Corridor” mode is 10 %.



5.2.5 Open-plan office including standby


5.2.5.1 Requirements

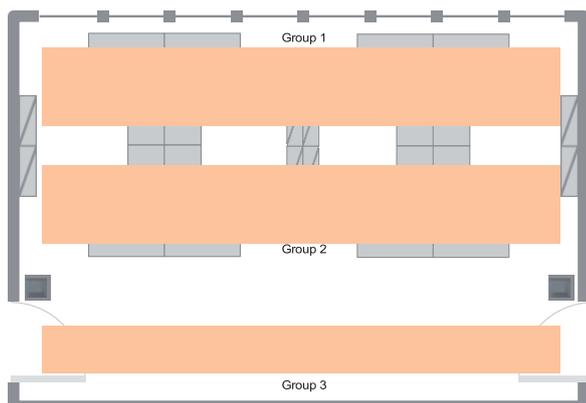

The open-plan office luminaires are divided into three light groups which can be switched and dimmed.

The lights will be switched on automatically when a person enters the room and dimmed down to a standby level after a 15-minute delay time if no presence is detected.

During presence, the daylight harvesting function will dim the artificial light up and down according to the amount of daylight available.

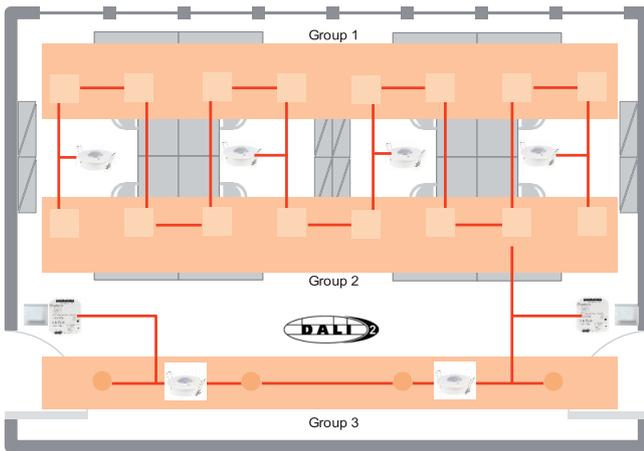


Solution with

1 x FLEX CU FM DALI-2 TW
DALI controller
(best mounted in a flush box)

Standard DALI-2 luminaires
16 x Panel luminaires
4 x Downlights

1 x DALI-2 PB coupler

6 x DALI-2 sensor
Light and presence detector for ceiling integration

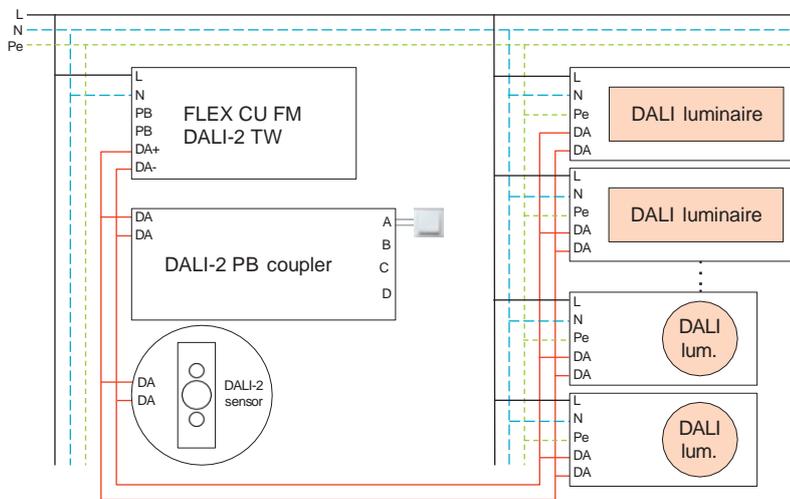

5.2.5.3 Out-of-the-box features (no app for configuration needed!)

Attention: For this application, the out-of-the-box features are **not** sufficient.

Additional configuration via the **DALI CONFIG APP** is required (see chapter 5.2.3.4 ff.)!

5.2.5.4 Configuration via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG APP. The DALI CONFIG APP configuration is **mandatory** for this application!

The grouping feature needs to be activated, the HCL function needs to be de-activated, and the two pushbuttons need to be configured as well.



Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP for **two hours only (if no admin password is stored)**. After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.2.5.5 Password protection

Please see 5.2.1.5: Password protection


5.2.5.6 Change of default setup

The default setup of the control unit is the “Single Office” mode, which needs to be changed to the “Open-plan office” mode first.



Change of default setup

1. Open the main menu.
2. Open “Current configuration”.
3. The “Single office” profile is activated by default.
4. Click on “Load a profile”.
5. Select the “Open-plan office” profile and click on “OK” to save this change of configuration.

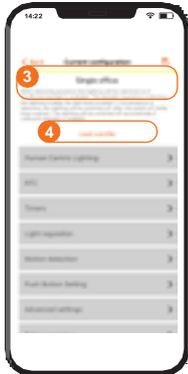

5.2.5.7 Standby level and time

When the “Open-plan office” mode is activated (see chapter 5.2.5.6), the light will go to the pre-defined standby level of 30 % after the switch-off delay time has expired. The light will switch off after one hour if no presence is detected during the standby time.



Choose the standby level and time

1. Open the main menu.
2. Open “Current configuration”.
1. Open “Advanced settings”.

Choose the required “Standby level” and “Standby time”.

Default values in “Open-plan office” mode:

Standby level = 30 %
Standby time = 1 hour



5.2.5.8 Grouping

According to the open-plan office requirements, the luminaires need to be grouped to realize the three different light groups.



Group the luminaires

1. Open the main menu.
2. Open “Grouping” in the main menu.
3. Start the addressing procedure by selecting “Activate Grouping”.
4. All found LED drivers will be listed and automatically assigned to group 1.



After selecting a device, the connected luminaire starts flashing.

5. After selecting the group number, the number changes 1-2-3-4-1 ..., as up to four groups can be configured.

Group 1 = Window row light
 Group 2 = Center row light
 Group 3 = Corridor row light



5.2.5.9 DLHV function with defined light group offset

Depending on the availability of natural daylight and the room setup, the light regulation provides the right amount of light according to the needs of the customer. As the DLHV function is dedicated to group 1 only, the other light groups – group 2 and group 3 – have to be run with a defined offset compared to group 1 to guarantee an equal light distribution throughout the room.



Define the light group offset


1. Open the main menu.
2. Open “Current configuration”.
3. Now open the “Light regulation”.
4. Activate the “Group 2 Light Regulation” and define the “Offset” according to room requirements.



Repeat step 4 for the “Group 3 Light Regulation” setup.

5.2.6 Open-plan office including Swarm function

5.2.6.1 Requirements

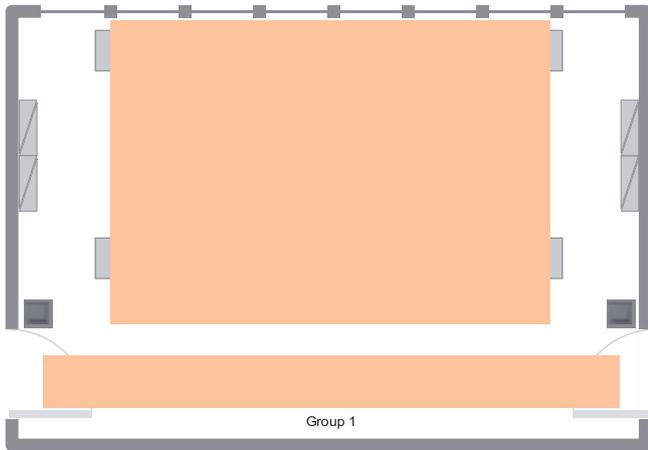


The open-plan office luminaires are floor-standing luminaires in the desk area and downlights in the corridor area. The desk luminaires are wirelessly interconnected and react as a big swarm as soon as presence is detected by one of the Swarm luminaires.

The lights will be switched on automatically when a person enters the Swarm zone. If no presence is detected anymore, the lights will be dimmed down to standby level after a 15-minute delay time.

During presence, the daylight harvesting function will dim the artificial light up and down according to the amount of daylight available.

5.2.6.2 Application setup and wiring diagram

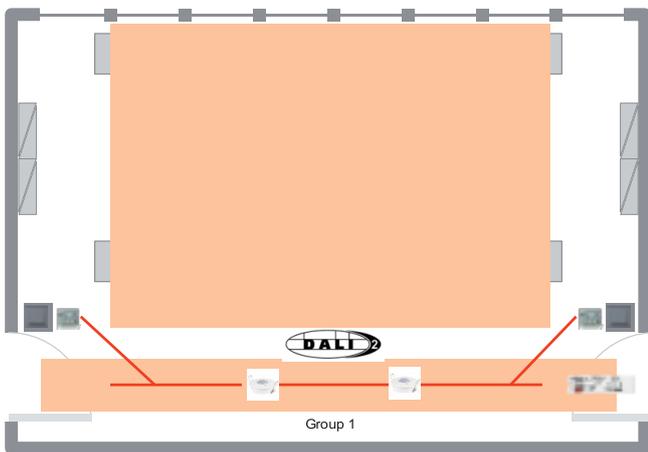

Solution with FLEX CU DALI-2 TW

8 x floor-standing DALI-2 luminaire

DALI luminaire with integrated FLEX CU DALI-2 TW Control device and DALI-2 sensor

4 x standard DALI luminaire

1 x FLEX CU DALI-2 TW


2 x DALI-2 PBC coupler

2 x DALI sensor


Light and presence detector for ceiling integration



a) Wiring diagram of floor-standing luminaires shown in the Swarm zone

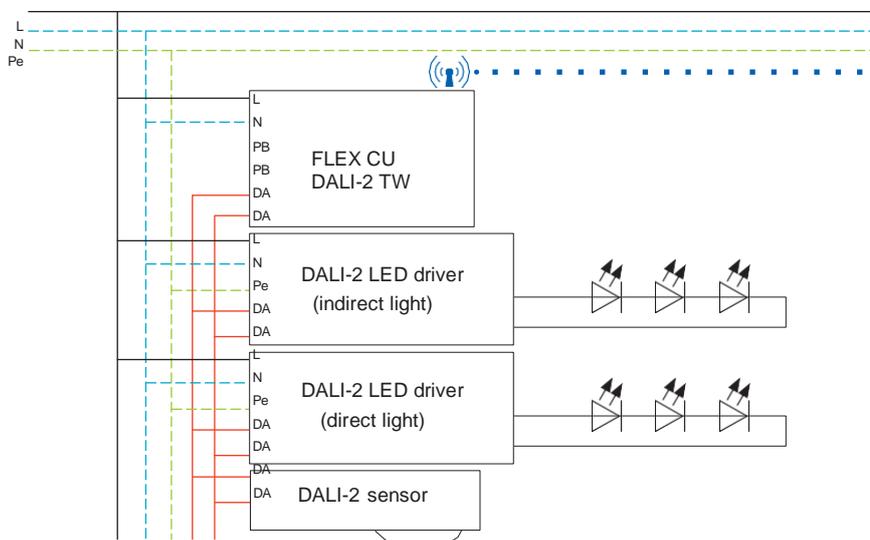

b) Wiring diagram of group 1 with standard DALI luminaires

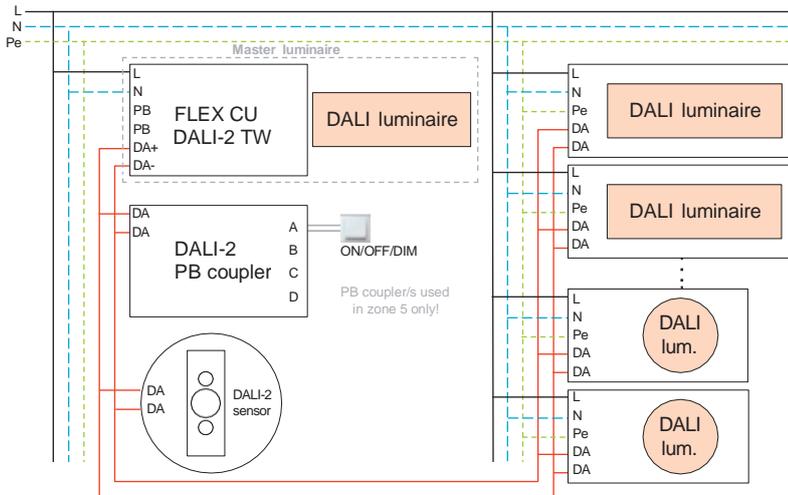

5.2.6.3 Out-of-the-box features (no app for configuration needed!)

Attention: For this application, the out-of-the-box features are **not** sufficient.

Additional configuration via the **DALI CONFIG APP** is required (see chapter 5.2.6.4 ff.)!

5.2.6.4 Configuration via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG APP. The DALI CONFIG APP configuration is **mandatory** for this application!

The grouping feature needs to be activated, the HCL function needs to be de-activated, and the two pushbuttons need to be configured as well.



Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP **for two hours only (as long as no admin password is stored)**. After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.2.6.5 Password protection

Please see 5.2.1.5: Password protection

5.2.6.6 Activation of Swarm feature via Expert mode



Activate the Swarm feature

Eight (8) FLEX Control devices in the Swarm zone need to be connected – one by one!

1. Open the main menu.
2. Open “Settings”.
3. Open “Profile”.

Please enter the following:


4. Name = **ExpertUser**
Company = **Ledvance**

5. Click on “Save”.

Go back to the main menu.


The profile change can now be identified by:

Name = **ExpertUser**
6. Additional Menu Item = **Diagnostic**

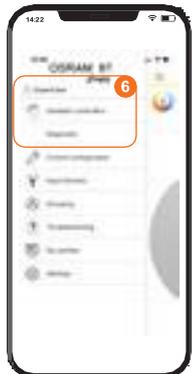

5.2.6.7 Swarm zone creation

Depending on the room setup, the independent desk luminaires can be integrated into a Swarm zone. A wireless information transfer between the luminaires is guaranteed due to the activated Swarm feature in each FLEX Control device. Each of the luminaires will switch on when presence is detected and all other Swarm luminaires will react accordingly.

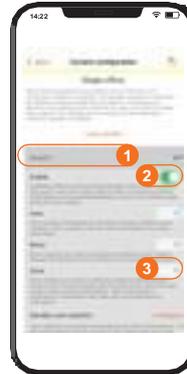

Create the Swarm zone/s

1. Open “Swarm”.
2. Enable the “Swarm function” for **this** FLEX Control.
3. Now check which area, room and zone **this** FLEX Control belongs to, as each of the **eight FLEX Control devices** needs to be in the same **Swarm zone**.

Important information:

- **System boundaries:**
 - Max. 20 participants in one zone
 - Max. 20 different zones
 - Max. 50 different rooms
 - Max. 50 different areas
- Presence information **can only be exchanged** between controllers with the **same area and room number**.

Now scroll down in the Swarm menu:

4. Check the “Switch off delay”.
5. Enable “Activate standby level”.
6. Define the “Standby level” and “Standby time” for **this** FLEX Control.

Attention: All FLEX Control devices linked in zone/s should have the same parameters programmed for an even and timely light distribution!


Important note:

If the FLEX Control devices is connected to the DALI CONFIG APP, the Swarm feature is **not working** because the Swarm connection is blocked by the app! Therefore, it is necessary to **disconnect the DALI CONFIG APP first**. The **Swarm connection/s** between the FLEX controllers **will only be established afterwards**.



5.2.7 Open-plan office including Swarm function and zone division

5.2.7.1 Requirements

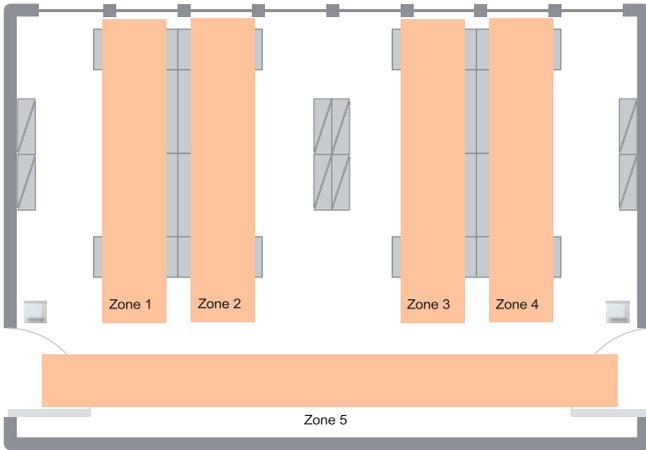


The open-plan office luminaires are floor-standing luminaires in the desk area and downlights in the corridor area. They are divided into five light zones.

The lights will be switched on automatically when a person enters a respective zone, while luminaires in linked zones will go to a pre-defined standby level. If no presence is detected anymore, the light will be dimmed down to standby level after a 15-minute delay time.

During presence, the daylight harvesting function will dim the artificial light up and down according to the amount of daylight available.

5.2.7.2 Application setup and wiring diagram

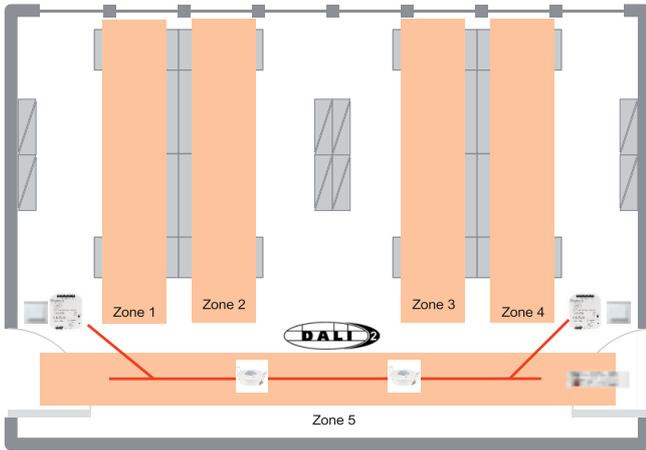

Solution with FLEX CU DALI-2 TW

8 x floor-standing DALI luminaire
DALI luminaire with integrated FLEX CU DALI-2 TW Control unit and DALI-2 sensor

4 x standard DALI-2 luminaires

1 x FLEX CU DALI-2 TW


2 x DALI-2 PB coupler

2 x DALI-2 sensor


Light and presence detector for ceiling integration



c) Wiring diagram of floor-standing luminaires shown in zones 1-4

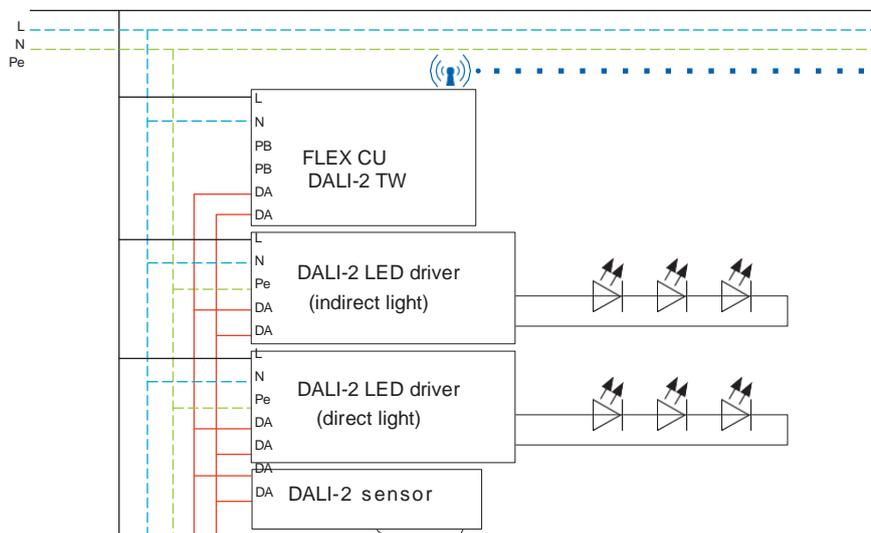

d) Wiring diagram of zone 5 with standard DALI luminaires

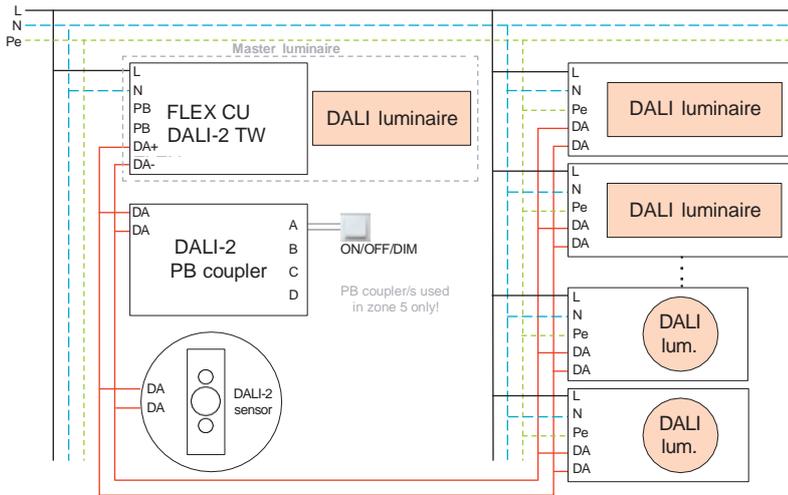

5.2.7.3 Out-of-the-box features (no app for configuration needed!)

Attention: For this application, the out-of-the-box features are **not** sufficient.

Additional configuration via the **DALI CONFIG APP** is required (see 5.2.5.4 ff.)!

5.2.7.4 Configuration via the DALI CONFIG APP

The controller can be configured via smartphone with the DALI CONFIG APP.

The DALI CONFIG APP configuration is **mandatory** for this application!

The grouping feature needs to be activated, the HCL function needs to be deactivated, and the two pushbuttons need to be configured as well.



Important note:

After powering up the controller, it can be configured with the DALI CONFIG APP **for two hours only (as long as no admin password is stored)**. After the two-hour delay time has expired, connecting to the controller with the DALI CONFIG APP is blocked. The timer can be reset by power-cycling the controller. When an admin password is set, the access to the controller will no longer expire.

The following features are a selection of the most popular project-specific adaptations. There are also many additional settings which can be looked up in the app.

5.2.7.5 Password protection

Please see 5.2.1.5: Password protection

5.2.7.6 Activation of Swarm feature via Expert mode



Activate the Swarm feature

Nine (9) FLEX Control devices need to be connected – one by one!

1. Open the main menu.
2. Open “Settings”.
3. Open “Profile”.



Please enter the following:
 4. Name = **ExpertUser**
 Company = **Ledvance**

5. Click on “Save”.

Go back to the main menu.

The profile change can now be identified by:

- Name = **ExpertUser**
 6. Additional Menu Item = **Diagnostic**

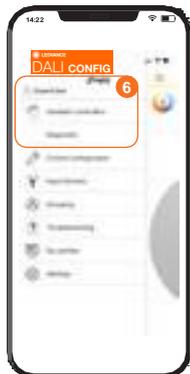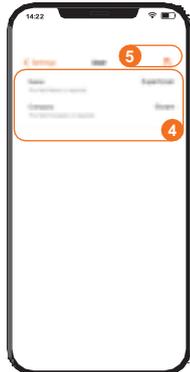

5.2.7.7 Creation of different Swarm zone/s

Depending on the room setup, the independent desk luminaires can be integrated into different light zones. A wireless information transfer between zones is guaranteed due to the

activated Swarm feature in each FLEX Control device. Nevertheless, each of the zones will react independently and switch on their lights when presence is detected. Additionally, lights in other zone/s can react as well, according to the configuration for each of the linked zones.



Create the Swarm zone/s

1. Open “Swarm”.
2. Enable the “Swarm function” for **this** FLEX Control.
3. Now choose which zone (1 to 5) **this** FLEX Control belongs to, as each of the **nine FLEX Control devices** needs to be in **different zone/s** for standby feature.
4. Click on “Configure” in “Standby zone selection”.



5. Define the **standby zone/s** for **this** FLEX Control.

Important information:

- System boundaries:
 - Max. 20 participants in one zone
 - Max. 20 different zones
 - Max. 50 different rooms
 - Max. 50 different areas
- Presence information **can only be exchanged** between controllers with the **same area** and **room number**.



- Configuration of standby zone/s: The standby zone/s are the zone/s which go into standby mode while **this** FLEX Control is triggered by presence detected!
For example: **This** FLEX Control is in **zone 4**. The standby zone/s triggered by presence detection of **this** FLEX Control can be freely chosen – e.g. zone 5 only or zones 3 and 5 or even **all** other zones, meaning zones 1, 2, 3 and 5.

Now scroll down in the Swarm menu:

6. Check the “Switch off delay”.
7. Enable “Activate standby level”.
8. Define the “Standby level” and “Standby time” for **this** FLEX Control.

Attention: All FLEX Control devices linked in zone/s should have the same parameters programmed for an even and timely light distribution!

Important note:

If the **FLEX Control device is connected to the FLEX Config App**, the Swarm feature is **not working** because the Swarm connection is blocked by the app! Therefore, it is necessary to **disconnect the FLEX Config App first**. The **Swarm connection/s** between the FLEX controllers **will only be established afterwards**.

Service contact:

LEDVANCE GmbH

Parking 1-5, 85748 Garching, Germany

contact@ledvance.com

